


NOTES:

SEE TYPICAL FOR WASHER INSTALLATION
ALL FRESH WATER LINES ARE 1/2" UPONDR PEX
DRAINS ARE INSTALLED AT LOW POINTS
BELOW MAIN FLOOR
TEI LISTED SWIVEL CONNECTIONS (LISTING #17062)
*-DENOTES 1/2" X 48" FAUCET RISER

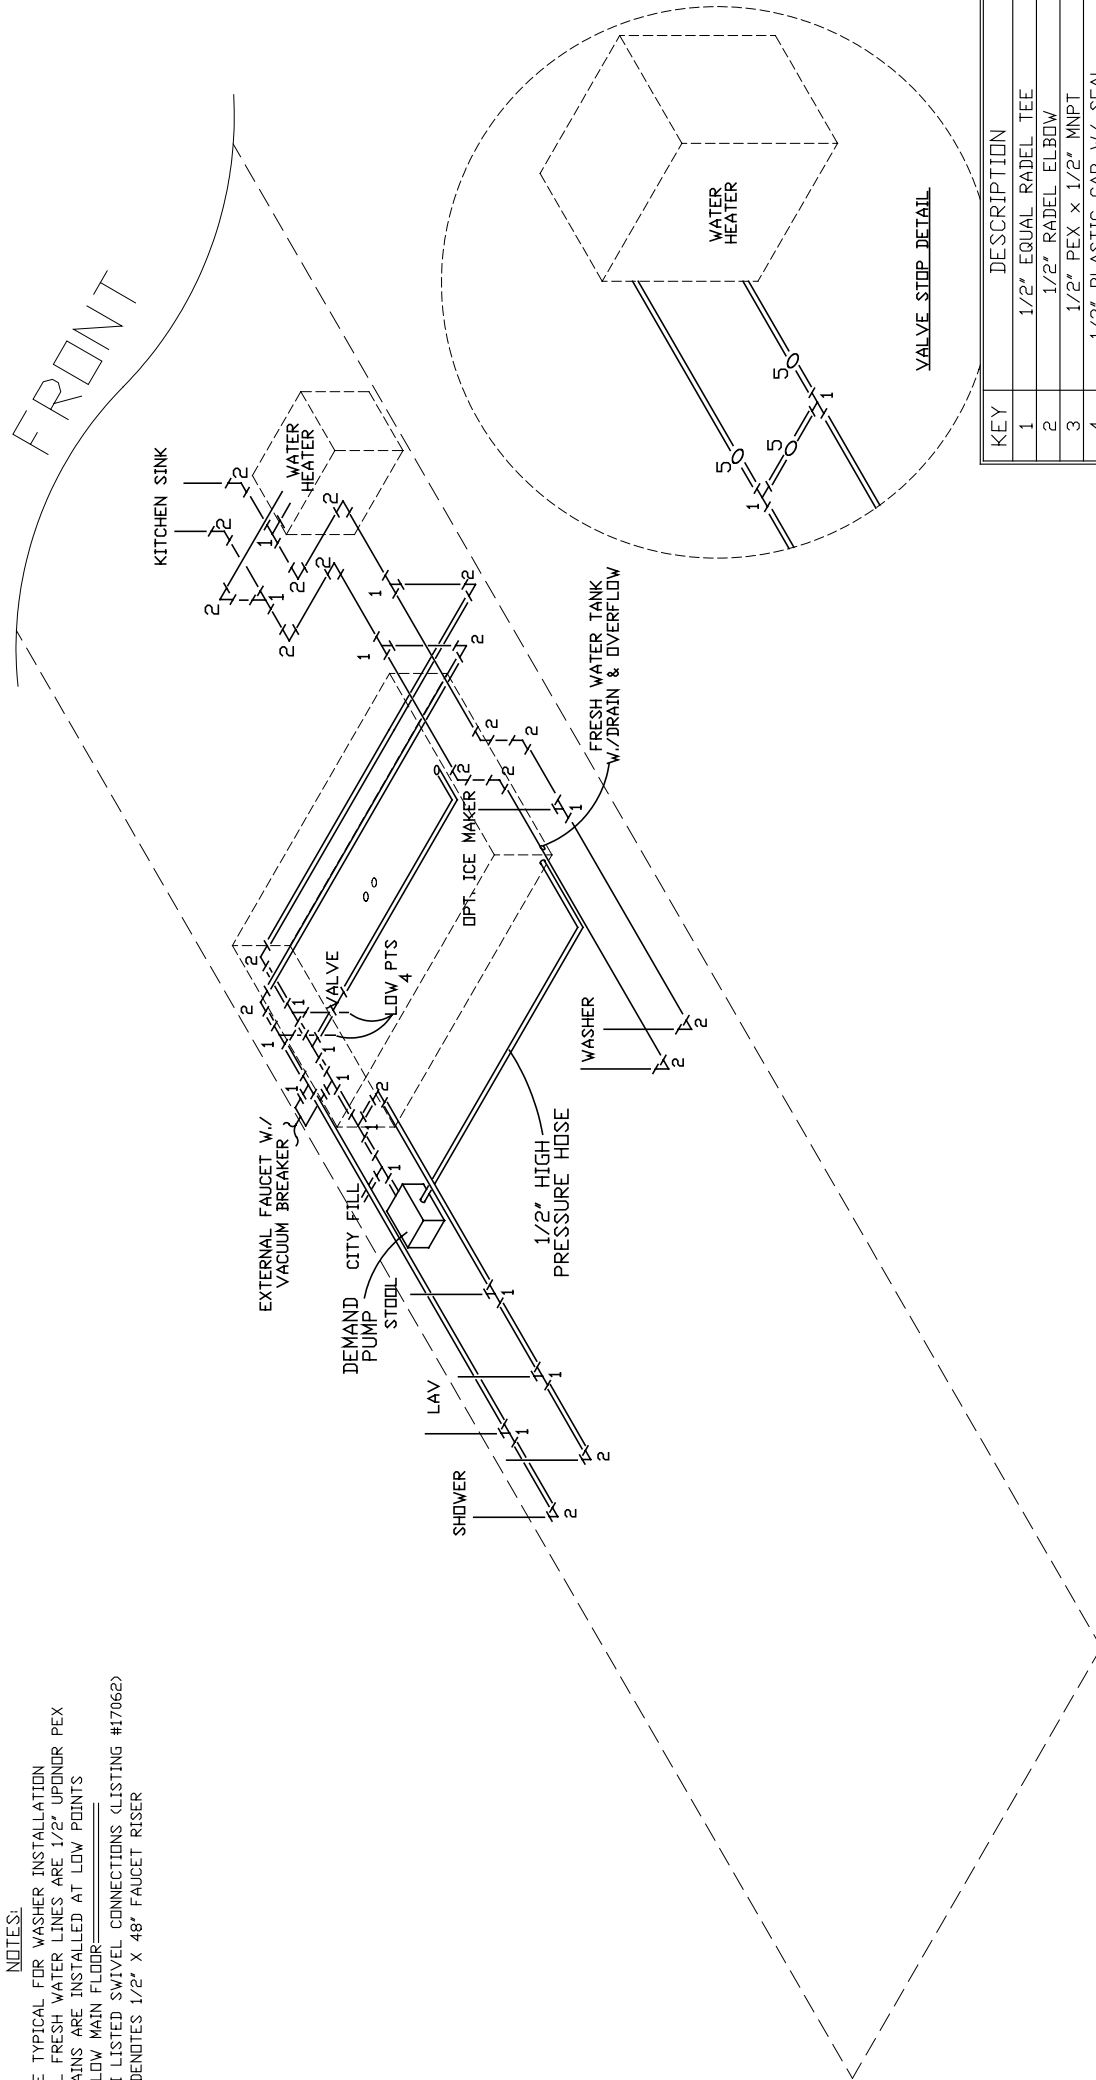

KEY	DESCRIPTION
1	1/2" EQUAL RADEL TEE
2	1/2" RADEL ELBOW
3	1/2" PEX x 1/2" MNPT
4	1/2" PLASTIC CAP W/ SEAL
5	PEX VALVE STOP 1/2" B X 1/2" B BLK

NEWMAR CORP P.O. Box 30, Nappanee, IN. 46550 Title block-PB_TB-M9_A	Model:	Sheet 2 OF 3 I.D. # 2009\ME\CODE\PLUM\AT\4154	Drawn by:	Checked by: J. B. Date: 12/24/07	Revision:	
	Title: WATER LINES		R. N.		By:	Date:

SIZE OF TRAP ARM (IN)	DISTANCE FROM TRAP TO VENT (FT.)
1 1/4	4 1/2
1 1/2	4 1/2
2	5
3	6



KEY	SYM	DESCRIPTION	KEY	SYM	DESCRIPTION
1		2"x1 1/2" REDUCER	13A		LG SWP TY-1 1/2"
2		CLOSEST FLANGE-4"x3"	13C		LG SWP TY-3"x3"x2"
3A		45° ELL-1 1/2"	13D		LG SWP TY-3"x2"x3"
3B		45° ELL-2"	13E		LG SWP TY-2"x2"x1 1/2"
3C		45° ELL-3"	13F		LG SWP TY-2"x1 1/2"x2"
6A		90° ELL-1 1/2"	13G		LG SWP TY-2"x1 1/2"x1 1/2"
6B		90° ELL-2"	13H		LG SWP TY-3"
8A		90° LG SWP ELL-1 1/2"	13K		LG SWP TY-3"x3"x1 1/2"
8B		90° LG SWP ELL-2"	13J		LG SWP TY-3"x1 1/2"x3"
8C		90° LG SWP ELL-3"	14		DBL LG SWP TY-3"
11A		SAN TEE-1 1/2"	14C		DBL TY-3"
11B		SAN TEE-2"x1 1/2"x2"	15A		TEE WYE-1 1/2"
11C		SAN TEE-2"x2"x1 1/2"	16		P-TRAP W/UNION JOINT
11D		1 1/2" CLEAN OUT	17		TEE WYE-2"
11E		1 1/2" CHECK VENT	18		2" CLEAN OUT
			19		CLOSEST FLANGE 45°

Model:	Sheet	Drawn by:	Checked by:	Revision:
NEWMAR CORP P.O. Box 30, Nappanee, IN. 46550	3 OF 3	R. N.	J. B.	
Title:	I.D. #	Date:	Date:	By:
DRAIN PLUMBING	ME\CODE\PLUMB\AT\4154	12/18/07	12/24/07	
Title block-PB-TB-M9-A				Date: