

NOTES:

SEE TYPICAL & FITTINGS ARE AS SHOWN #40
ALL FITTINGS ARE 90° LONG TURN UNLESS SPECIFIED
DRAIN MATERIALS USED IN THE DRAINAGE SYSTEM CONFORM TO NFPA 1192 7.1.1
BEHIND WALLS OR UNDER FLOORS AT 1/2" INCH PER FOOT MINIMUM
TEI DRAIN LINES ARE SUPPORTED AT A MAXIMUM INTERVAL OF 4 FEET
* - MAXIMUM TRAP ARM LENGTH IS 5'

ALL TRAPS ARE A MINIMUM REQUIRED SIZE OF 1 1/4"
ALL TANK HOOKUPS ARE A DOUBLE LTTY UNLESS SPECIFIED OTHERWISE
IN OR BELOW MAIN FLOOR


ALL CLEAN OUTS ARE 1 1/2" WYE'S

SEE WASHER TYPICAL CONNECTIONS (LISTING #17062)

ALL TRAPS ARE REMOVABLE FOR USE AS A CLEANOUT ACCESS

* - DENOTES 1 1/2" CAF- FLEX


SIZE OF TRAP ARM (IN.)	DISTANCE FROM TRAP TO VENT (FT.)
1 1/4	4
1 1/2	1/2
2	4
3	5
	6

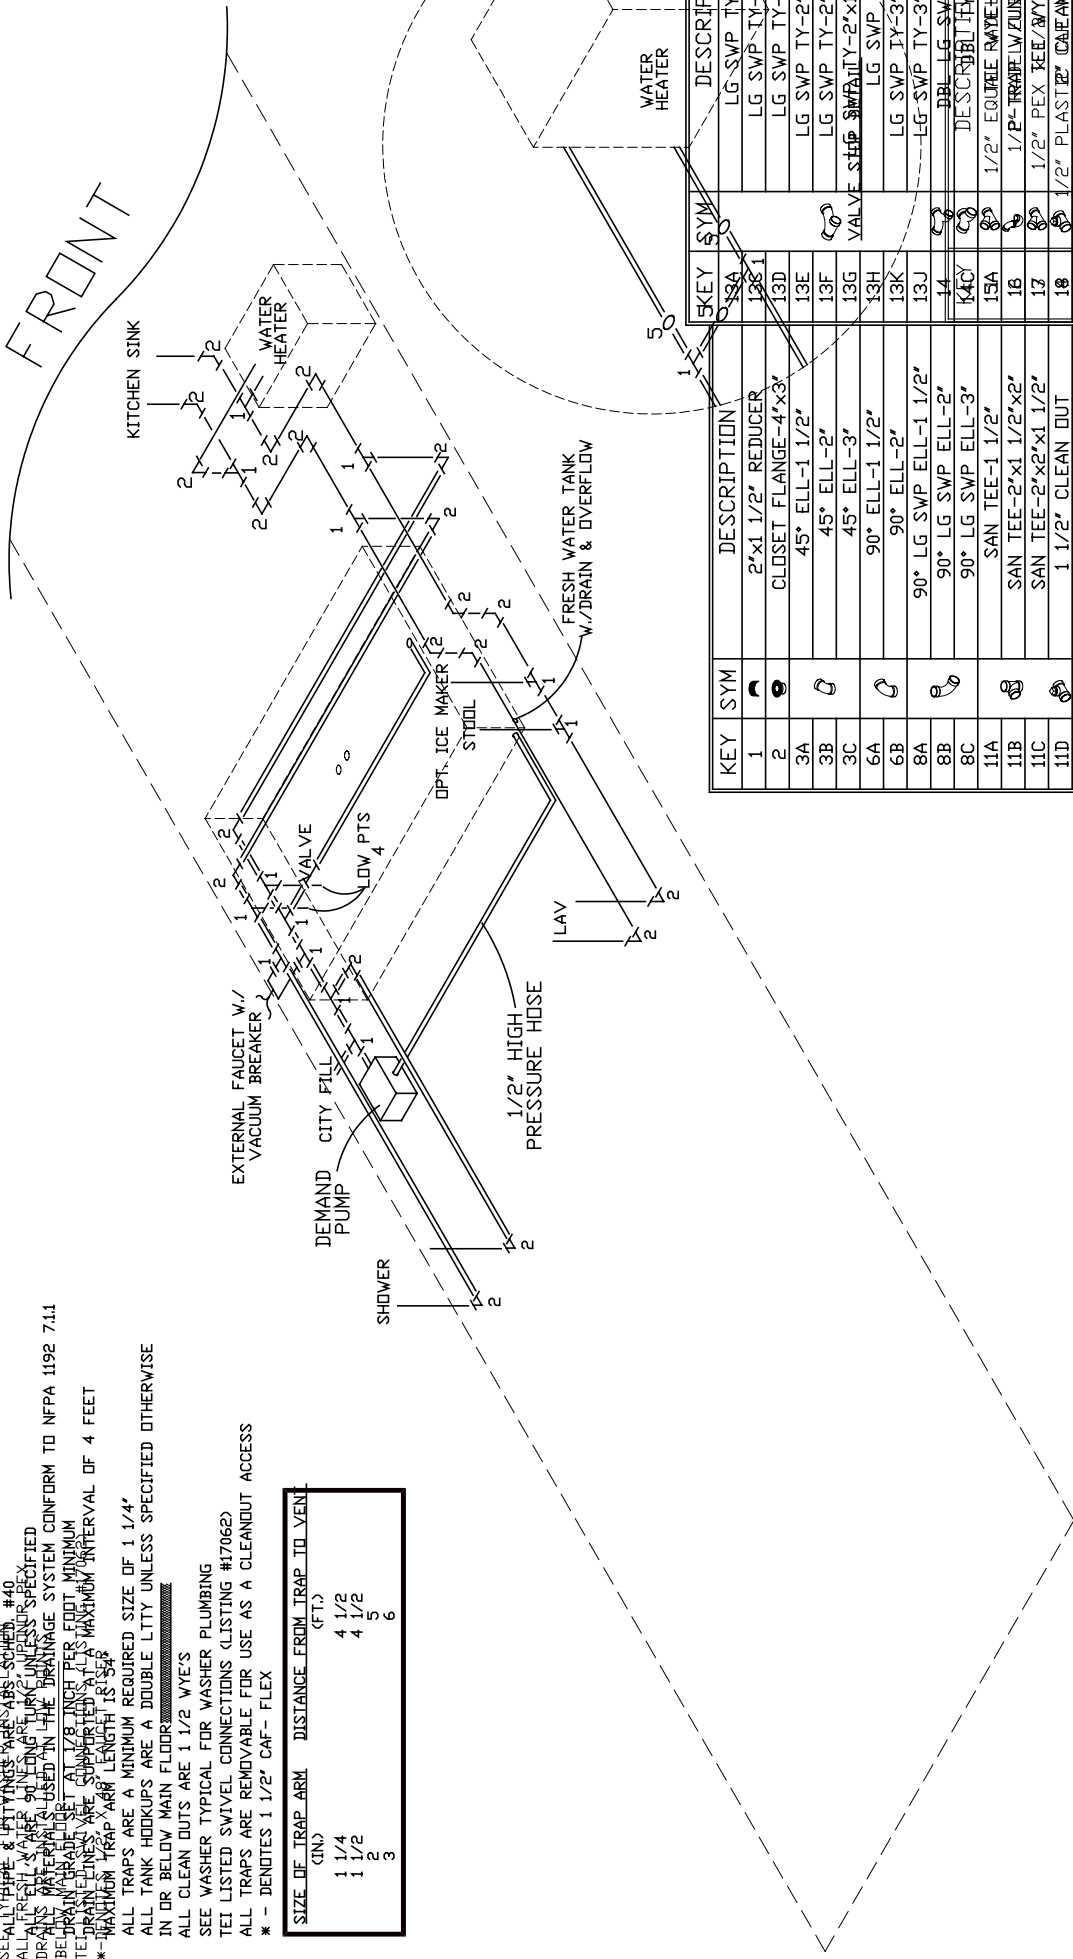

KEY	SYM	DESCRIPTION	KEY	SYM	DESCRIPTION
1	1	2"x1 1/2" REDUCER	13A	13A	LG SWP TY-1 1/2"
2	2	CLOSED FLANGE-4"x3"	13B	13B	LG SWP TY-2 3"x3"x2"
3A	3A	45° ELL-1 1/2"	13D	13D	LG SWP TY-3 3"x2"x3"
3B	3B	45° ELL-2"	13E	13E	LG SWP TY-2 2"x2"x1 1/2"
3C	3C	45° ELL-3"	13F	13F	LG SWP TY-2"x1 1/2"x2"
6A	6A	90° ELL-1 1/2"	13G	13G	VALVE SHIP TAIL TY-2"x1 1/2"x1 1/2"
6B	6B	90° ELL-2"	13H	13H	LG SWP TY-3"
8A	8A	90° LG SWP ELL-1 1/2"	13I	13I	LG SWP TY-3"x3"x1 1/2"
8B	8B	90° LG SWP ELL-2"	13J	13J	LG SWP TY-3"x1 1/2"x3"
8C	8C	90° LG SWP ELL-3"	14	14	DBL LG SWP TY-3"
11A	11A	SAN TEE-1 1/2"	14C	14C	DESCRIPTION TYPED
11B	11B	SAN TEE-2"x1 1/2"x2"	15A	15A	1/2" ELL TEE RAYE-1 1/2"
11C	11C	SAN TEE-2"x2"x1 1/2"	16	16	1/2" TRAP W/ FOUNTAIN JOINT
11D	11D	1 1/2" CLEAN OUT	17	17	1/2" PEX TEE/8" VENT
11E	11E	1 1/2" CHECK VENT	18	18	1/2" PLASTIC CAPEAM/DITAL
			19	19	1/2" VALVE SCOBSE/2" FLANGE/45° B BLK

Model:	NEWMAR CORP	Sheet	2 OF 3	Drawn by:	R. N.	Checked by:	B. S.	Revision:	By:
I.D. #	AT ME 4156	I.D. #	2009\	Date:	8/24/07	Date:	9/18/07	Date:	Date:
Title:	WATER LINES	ME\CODE\PLUM\AT	4156						
Title	block-PB_TB-M8_A								

SIZE OF TRAP ARM (IN)	DISTANCE FROM TRAP TO VENT (FT.)
1 1/4	4 1/2
1 1/2	4 1/2
2	5
3	6

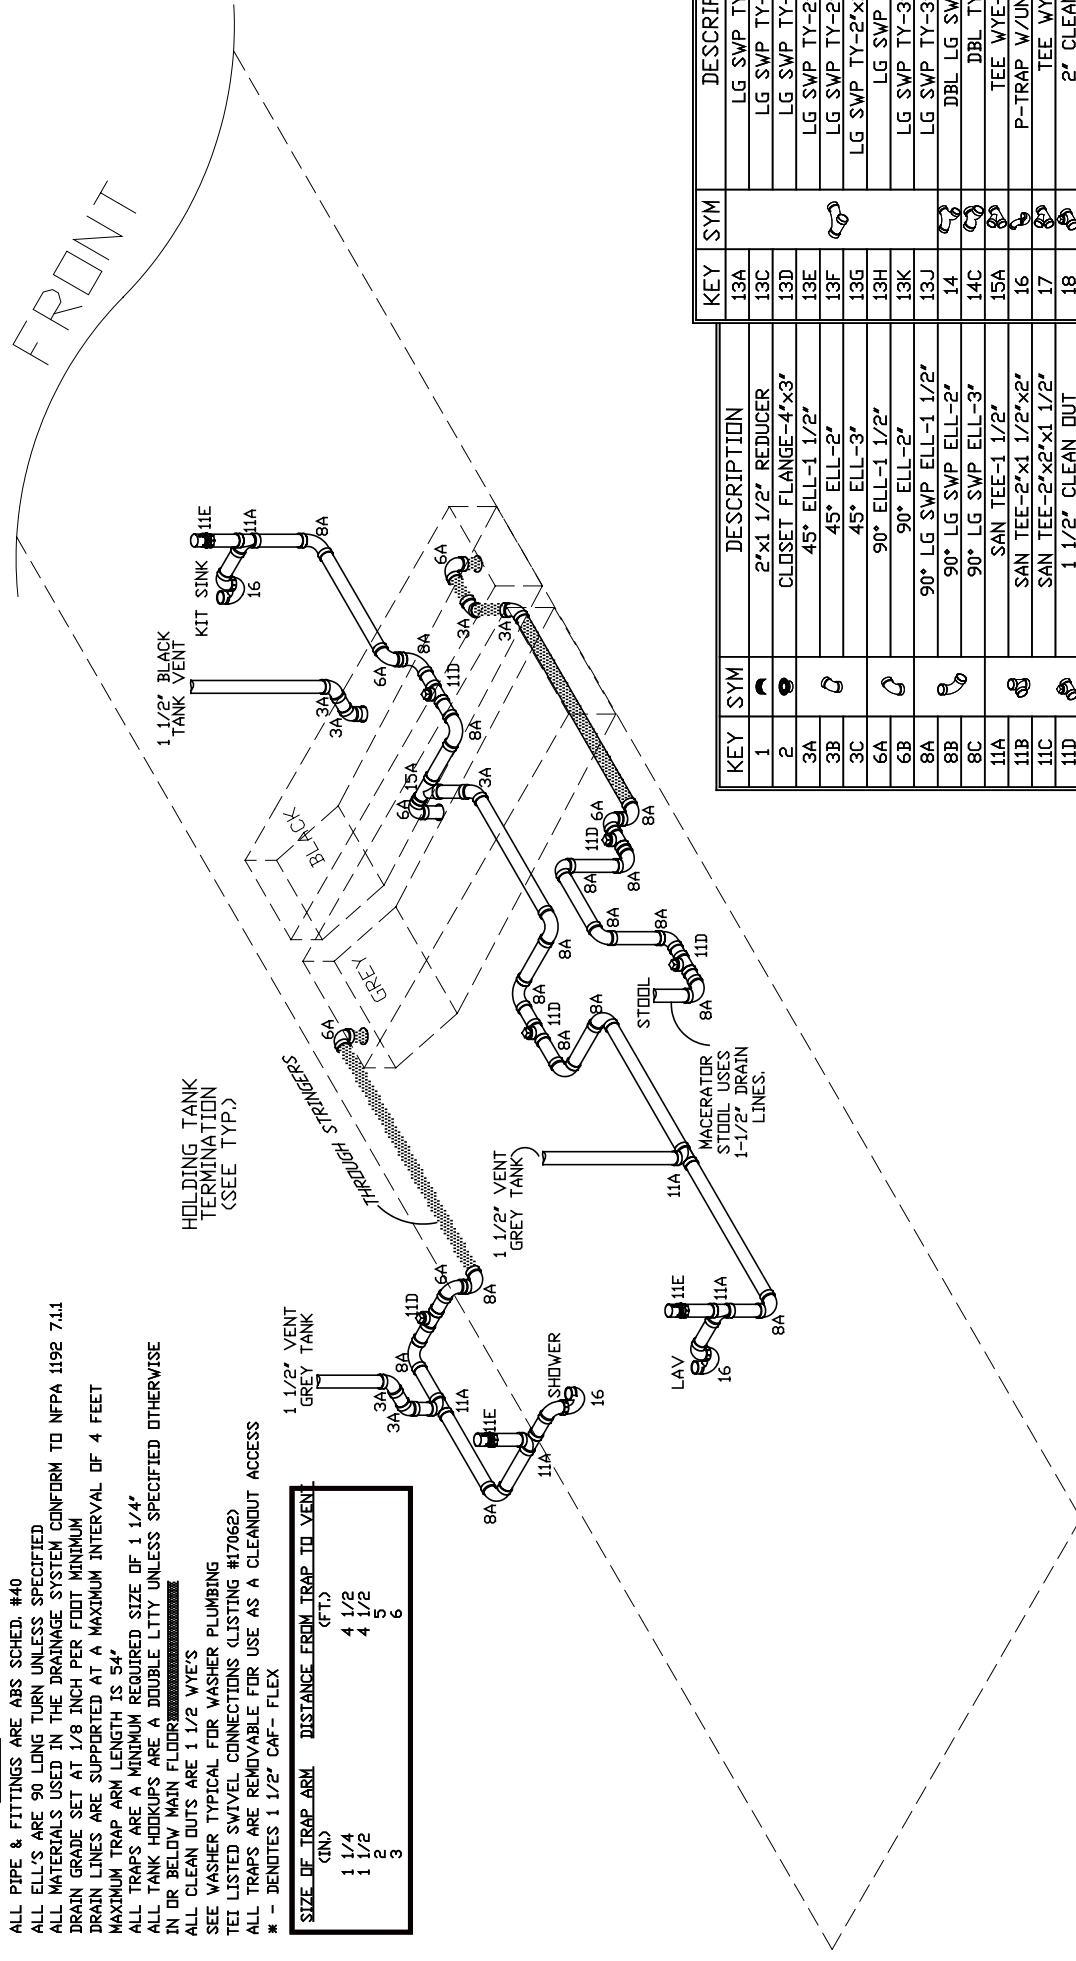

KEY	SYM	DESCRIPTION	KEY	SYM	DESCRIPTION
1		2"x1 1/2" REDUCER	13A		LG SWP TY-1 1/2"
2		CLOSEST FLANGE-4"x3"	13C		LG SWP TY-3"x3"x2"
3A		45° ELL-1 1/2"	13D		LG SWP TY-3"x2"x3"
3B		45° ELL-2"	13E		LG SWP TY-2"x2"x1 1/2"
3C		45° ELL-3"	13F		LG SWP TY-2"x1 1/2"x2"
6A		90° ELL-1 1/2"	13G		LG SWP TY-2"x1 1/2"x1 1/2"
6B		90° ELL-2"	13H		LG SWP TY-3"
8A		90° LG SWP ELL-1 1/2"	13K		LG SWP TY-3"x3"x1 1/2"
8B		90° LG SWP ELL-2"	13J		LG SWP TY-3"x1 1/2"x3"
8C		90° LG SWP ELL-3"	14		DBL LG SWP TY-3"
11A		SAN TEE-1 1/2"	14C		DBL TY-3"
11B		SAN TEE-2"x1 1/2"x2"	15A		TEE WYE-1 1/2"
11C		SAN TEE-2"x2"x1 1/2"	16		P-TRAP W/UNION JOINT
11D		1 1/2" CLEAN OUT	17		TEE WYE-2"
11E		1 1/2" CHECK VENT	18		2" CLEAN OUT
			19		CLOSEST FLANGE 45°

Model: AT ME 4156	Sheet 3 OF 3	Drawn by: R. N.	Checked by: B. S.	Revision:	By:
Title: DRAIN PLUMBING	I.D. # 2009\ ME\CODE\PLUMB\AT\ 4156	Date: 8/24/07	Date: 9/18/07		
NEWMAR CORP P.O. Box 30, Nappanee, IN. 46550 Title block-PB_TB-M8-A					