


NOTES:

- um developed length - 70'
- Black mall pipe
- I.D. copper type "L"
- length of copper type to appliance per test
- ane Distribution System Complies With The Parameters Set By Table 5.3.4 (NFPA 1192)
- ass fittings below floor to be forged--not milled
- um developed length of flex hose - 72"

MAX BTU VALUES	
URNACE	40,000
NGE	29,800
FRIGERATOR	1,500
TER HEATER	12,000
TOTAL BTU	85,300

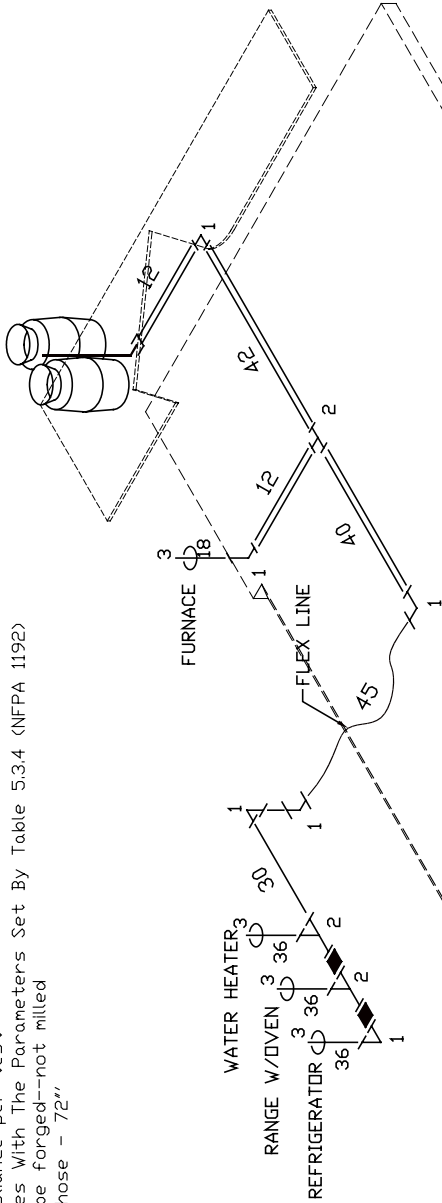

MAR CORP Box 30, nee, IN. 46550		Model: CPFW 35KSAH		Sheet 3 OF 3	Drawn by: M. B.	Checked by: D. B.	Revision/REMOVED "BY RVIA TEST" IN NOTES (PCR #87633)		By: M. B.
Title: PROPANE GAS		I.D. # 2009/		Date: 3/18/08		Date: 3/20/08		Date: 10/21/08	
ack--PB_TB-T4_09		TOW/COOE/PLUM/PP/PP/KSAH		Date: 3/18/08		Date: 3/20/08		Date: 9/9/08	

KEY	DESCRIPTION
1	1/2" BLK ELL
2	1/2" BLK TEE
3	1/2" FL x 3/8" BRASS UNION MPT

Mounting Clamp

-Rubber Coated Steel Clamp Used To Secure Gas Manifold

-Plastic Clamp Used To Secure Copper Tubing

-Grommets Used To Protect Copper Through Floors, Walls, Cab. Partitions, Etc.