

NOTES:

Maximum developed length - 70'

1/2" Black mall pipe

3/8" I.D. copper type "L"


Max. length of copper type to appliance per test

Propane Distribution System Complies With The Parameters Set By Table 5.3.4 (NFPA 1192)


All brass fittings below floor to be forged--not milled

Maximum developed length of flex hose - 72"

MAX BTU VALUES	
FURNACE	40,000
RANGE	29,800
REFRIGERATOR	1,500
WATER HEATER	12,000
TOTAL BTU	85,300

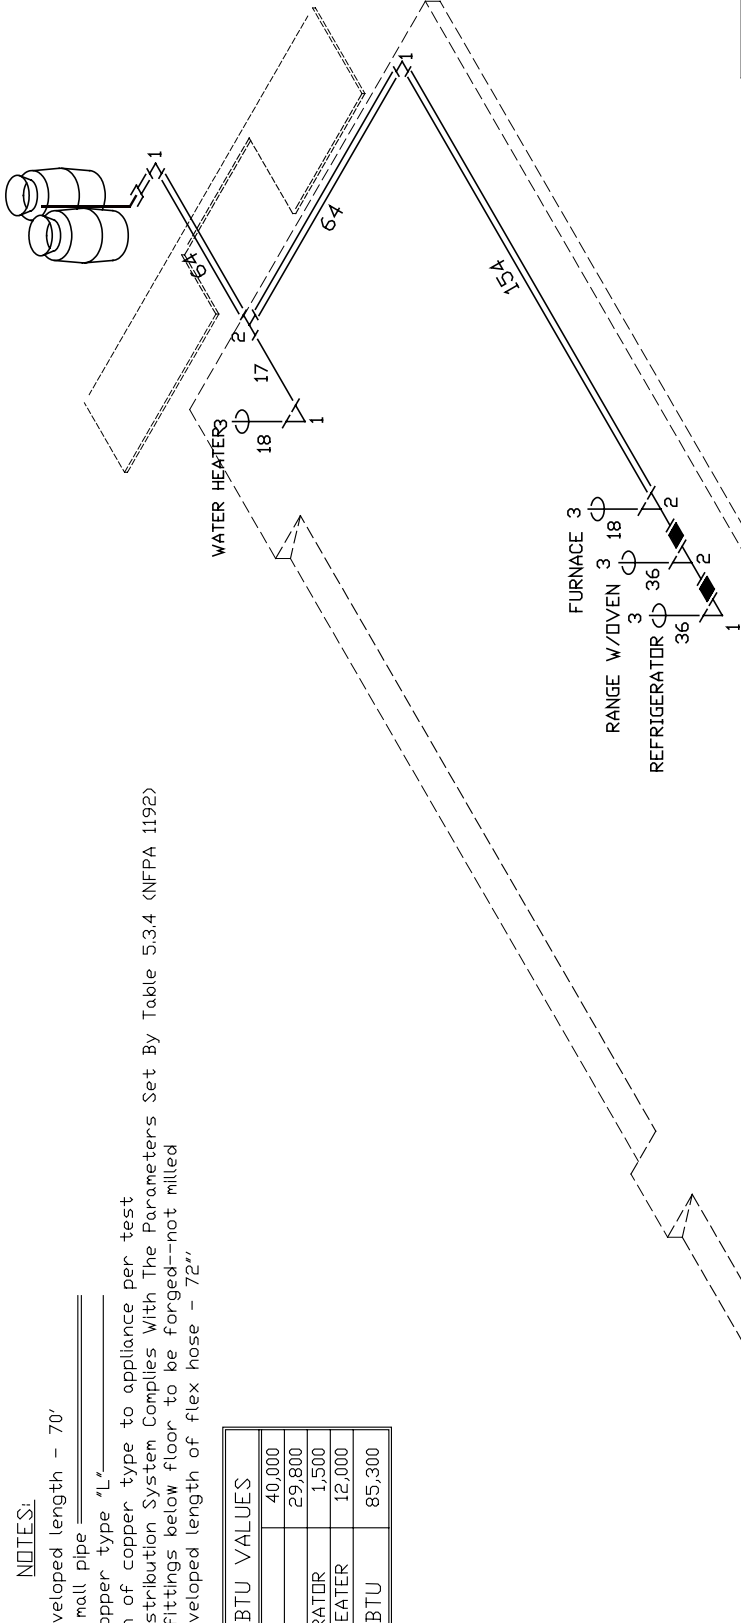

Mounting Clamp



- Rubber Coated Steel Clamp Used To Secure Gas Manifold
- Plastic Clamp Used To Secure Copper Tubing
- Grommets Used To Protect Copper Through Floors, Walls, Cab. Partitions Etc.

KEY

1 1/2" BLK ELL

2 1/2" BLK TEE

3 1/2" FL x 3/8" BRASS UNION MPT

Checked by:
D. B.

Date:
3/27/08

Drawn by:
T. M.

Date:
3/24/08

Sheet
3 OF 3

I.D. # 2009/
TOW/CODE/PLUM/CP/FV36RBDX

Model:
CPFW 36RBDX

Title:
PROPANE GAS

NEWMAR CORP
P.O. Box 30,
Napppanee, IN. 46550

Title block--PB_TB-T4_09

Revision:REV MAX BTU FOR FURNACE TO 40000 ILD 42000 (ECD #728)By: M.B.

Revision:REV MAX BTU FOR FURNACE TO 40000 ILD 42000 (ECD #728)By: M.B.

Revision:REV MAX BTU FOR FURNACE TO 40000 ILD 42000 (ECD #728)By: M.B.

Revision:REV MAX BTU FOR FURNACE TO 40000 ILD 42000 (ECD #728)By: M.B.

Revision:REV MAX BTU FOR FURNACE TO 40000 ILD 42000 (ECD #728)By: M.B.

Checked by:
D. B.

Date:
3/27/08

Drawn by:
T. M.

Date:
3/24/08

Sheet
3 OF 3

I.D. # 2009/
TOW/CODE/PLUM/CP/FV36RBDX

Model:
CPFW 36RBDX

Title:
PROPANE GAS

NEWMAR CORP
P.O. Box 30,
Napppanee, IN. 46550

Title block--PB_TB-T4_09

Revision:REV MAX BTU FOR FURNACE TO 40000 ILD 42000 (ECD #728)By: M.B.

Revision:REV MAX BTU FOR FURNACE TO 40000 ILD 42000 (ECD #728)By: M.B.

Revision:REV MAX BTU FOR FURNACE TO 40000 ILD 42000 (ECD #728)By: M.B.

Revision:REV MAX BTU FOR FURNACE TO 40000 ILD 42000 (ECD #728)By: M.B.

Revision:REV MAX BTU FOR FURNACE TO 40000 ILD 42000 (ECD #728)By: M.B.