

NOTES:

Maximum developed length - 70'

1/2" Black mll pipe

3/8" I.D. copper type "L"


Max. length of copper type to appliance per test

Propane Distribution System Complies With The Parameters Set By Table 5.3.4 (NFPA 1192)

All brass fittings below floor to be forged--not milled

Maximum developed length of flex hose - 72"

MAX BTU VALUES	
FURNACE	40,000
RANGE	29,800
REFRIGERATOR	1,500
WATER HEATER	12,000
TOTAL BTU	85,300

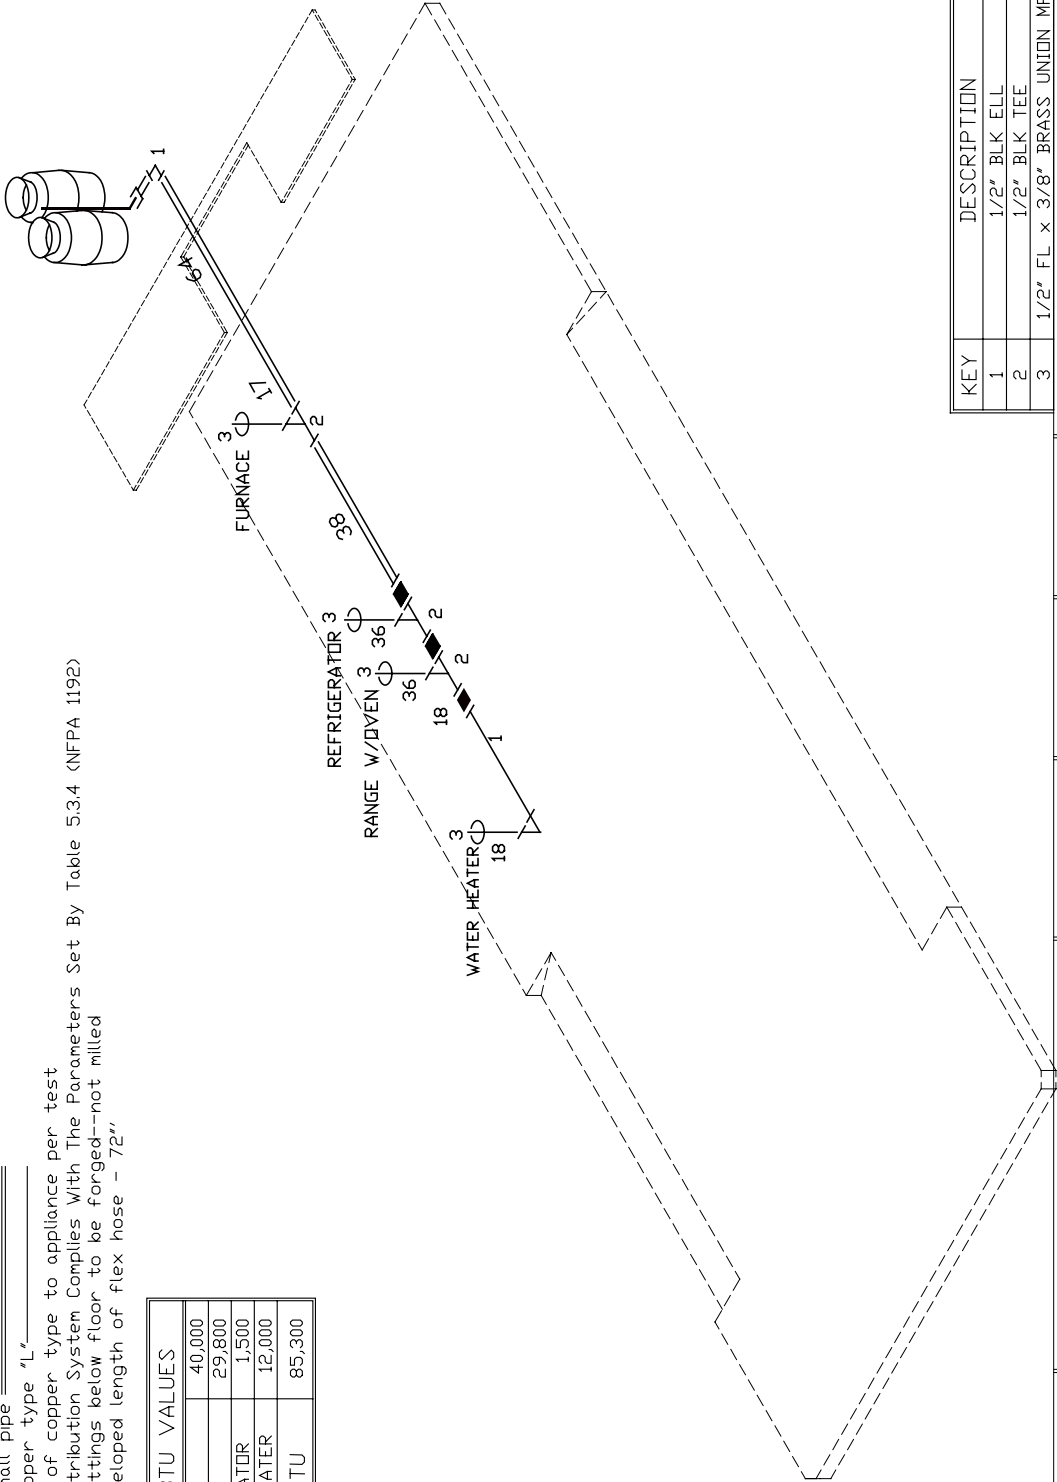


KEY	DESCRIPTION
1	1/2" BLK ELL
2	1/2" BLK TEE
3	1/2" FL x 3/8" BRASS UNION MPT

NEWMAR CORP P.O. Box 30, Nappanee, IN. 46550 Title block--PB_TB-T4_09	Model:	CPF W 36RLSK	Sheet	3 of 3	Drawn by:	M. B.	Checked by:	D. B.
	Title:	PROPANE GAS	I.D. #	2009/ TOW/CODE/PLUM/CP/FW36RLSK	Date:	1/25/08	Date:	2/11/08

Revision: REMOVED "BY RVIA TEST" IN NOTES (PCR #87633)		By:	M. B.
Revision: REV MAX BTU FOR FURNACE TO 40000 ILD 42000 (ECD #728)		Date:	10/21/08
		By:	M. B.
		Date:	9/9/08

Mounting Clamp



- Rubber Coated Steel Clamp Used To Secure Gas Manifold
- Plastic Clamp Used To Secure Copper Tubing
- Grommets Used To Protect Copper Through Floors, Walls, Cab. Partitions Etc.