


NOTES:

um developed length - 70'
Black mall pipe
I.D. copper type "L"
length of copper type to appliance per test
ane Distribution System Complies With The Parameters Set By Table 5.3.4 (NFPA 1192)
ass fittings below floor to be forged--not milled
um developed length of flex hose - 72"

MAX BTU VALUES	
VRNAGE	40,000
NGE	29,800
FRIGERATOR	1,500
TER HEATER	12,000
TOTAL BTU	85,300

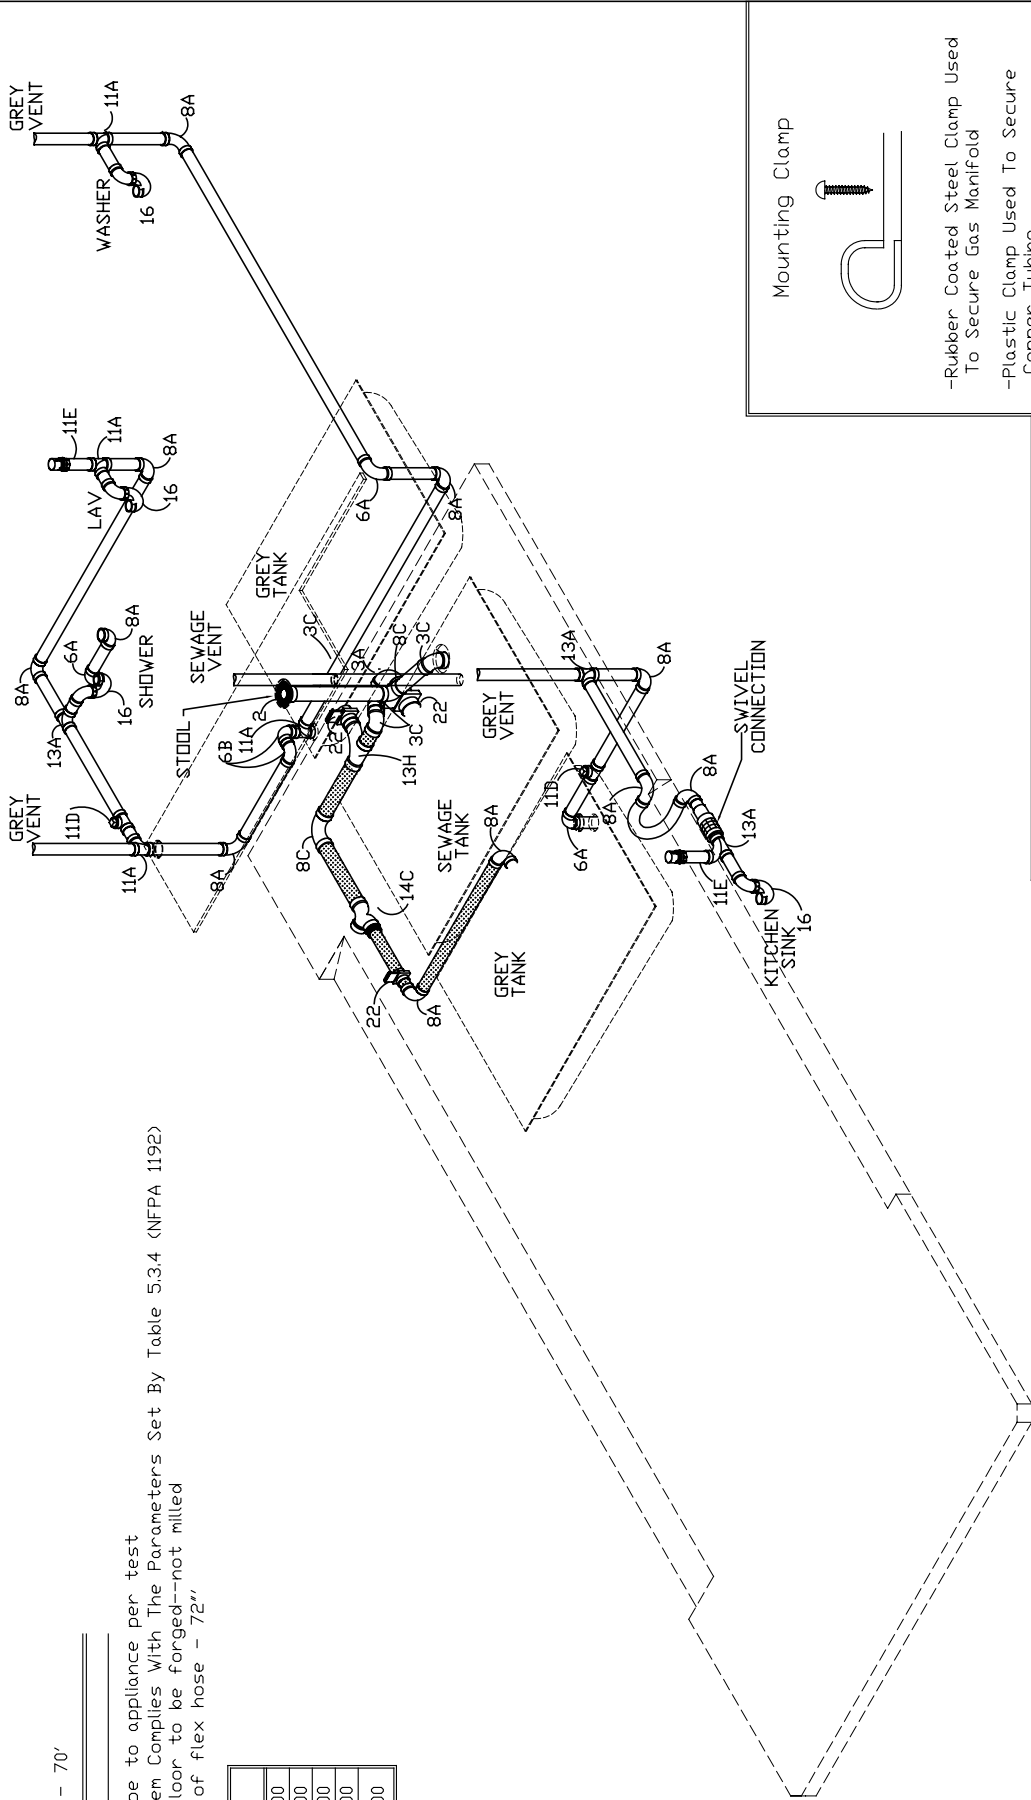

Mounting Clamp

-Rubber Coated Steel Clamp Used To Secure Gas Manifold

-Plastic Clamp Used To Secure Copper Tubing

-Grommets Used To Protect Copper Through Floors, Walls, Cab. Partitions, Etc.

KEY	DESCRIPTION
1	1/2" BLK ELL
2	1/2" BLK TEE
3	1/2" FL x 3/8" BRASS UNION MPT

MAR CORP P.O. Box 30, nee, IN. 46550 ack--PB_TB-T4_09	Model: CPFW 33RLSH Title: DRAIN PLUMBING	Sheet 1 OF 3	Drawn by: T. M.	Checked by: D. B.	Revision/REV WASHER PLUMBING FITTINGS TO 1 1/2" (ECO#577)			
		I.D. # 2009/ TOW/COOE/PLUM/CPFW33RLSH	Date: 1/17/08	Date: 2/7/08	By: M. B.	Date: 9/2/08		
						Revision/DELETE CLEAOUT FROM WASHER LINE		By: D. B.
								Date: 7/21/08


REVISED STOOL AND VENT PLUMBING

T. M.

4/23/08

NOTES:

Fresh water lines on Alres are 1/2" TuffPex-A
Fresh water lines on Stars are 1/2" TuffPex-A
s are installed at low points
listed swivel connections (listing #17062)
enotes 1/2" x 48" Faucet riser
all 18" high pressure hose at pump discharge

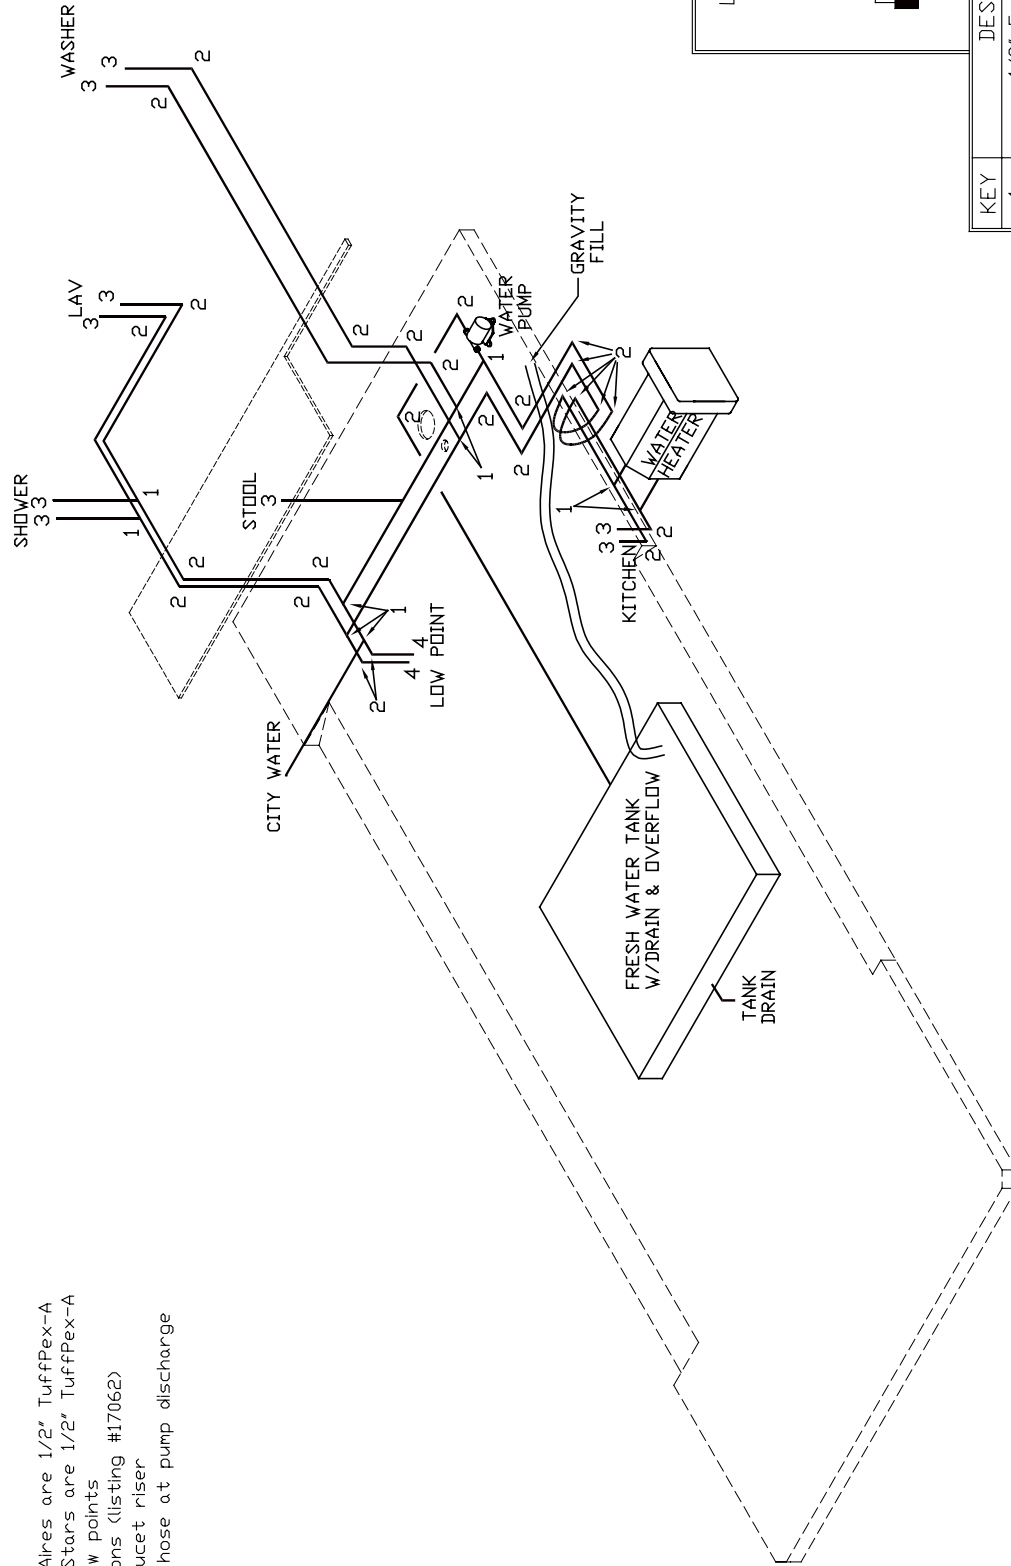

KEY	DESCRIPTION
1	1/2" Equal Radel Tee
2	1/2" Radel Elbow
3	1/2" Pex x 1/2" MNPT
4	1/2" Plastic Cap w/ Seal

MAR CORP Box 30, nee, IN. 46550 ck--PB_TB-T4_09	Model: CPFW 33RLSH Title: WATER LINES	Sheet 2 OF 3	Drawn by: T. M.	Checked by: D. B.	Revision:
		I.D. # 2009/ TOW/COOE/PLUM/CPFW33RLSH	Date: 1/17/08	Date: 2/7/08	By: Date: