

NOTES:

um developed length - 70'

Black mall pipe

I.D. copper type "L"


length of copper type to appliance per test

ane Distribution System Complies With The Parameters Set By Table 5.3.4 (NFPA 1192)


ass fittings below floor to be forged--not milled

um developed length of flex hose - 72"

MAX BTU VALUES	
RNACE	40,000
NGE	29,800
FRIGERATOR	1,500
TER HEATER	12,000
TOTAL BTU	85,300

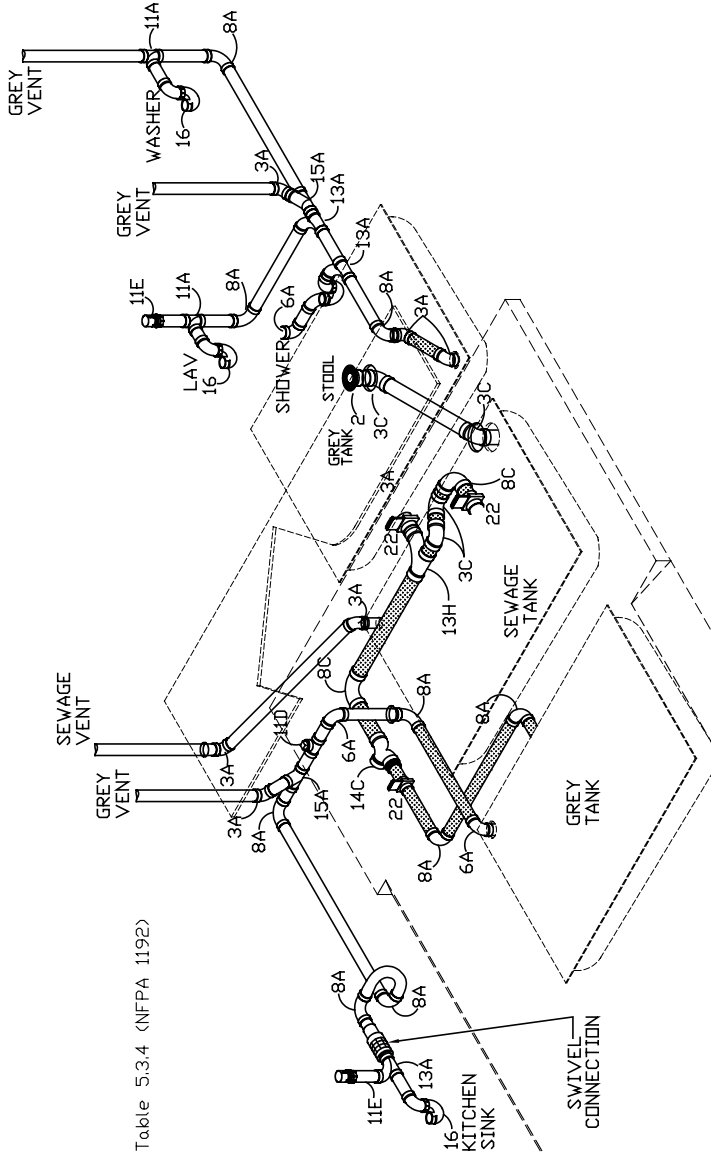

Mounting Clamp





- Rubber Coated Steel Clamp Used To Secure Gas Manifold
- Plastic Clamp Used To Secure Copper Tubing
- Grommets Used To Protect Copper Through Floors, Walls, Cab. Partitions, Etc.

KEY	DESCRIPTION
1	1/2" BLK ELL
2	1/2" BLK TEE
3	1/2" FL x 3/8" BRASS UNION MPT

MAR CORP P.O. Box 30, Hee, IN. 46550 ack--PB_TB-T4_09	Model: CPFW 35KSAH	Sheet 1 OF 3	Drawn by: M. B.	Checked by: D. B.	Revision: REV WASHER PLUMBING FITTINGS TO 1 1/2" (ECO#577)	
					By: M. B.	Date: 9/2/08
	Title: DRAIN PLUMBING	I.D. # 2009/ TOW/CODE/PLUMB/CPFW35KSAH	Date: 3/18/08	Date: 3/20/08	Revision: DELETE CLEANOUT FROM WASHER LINE	
					By: D. B.	Date: 7/21/08

NOTES:

Fresh water lines on Alres are 1/2" TuffPex-A
Fresh water lines on Stars are 1/2" TuffPex-A
s are installed at low points
listed swivel connections (listing #17062)
enotes 1/2" x 48" Faucet riser
till 18" high pressure hose at pump discharge

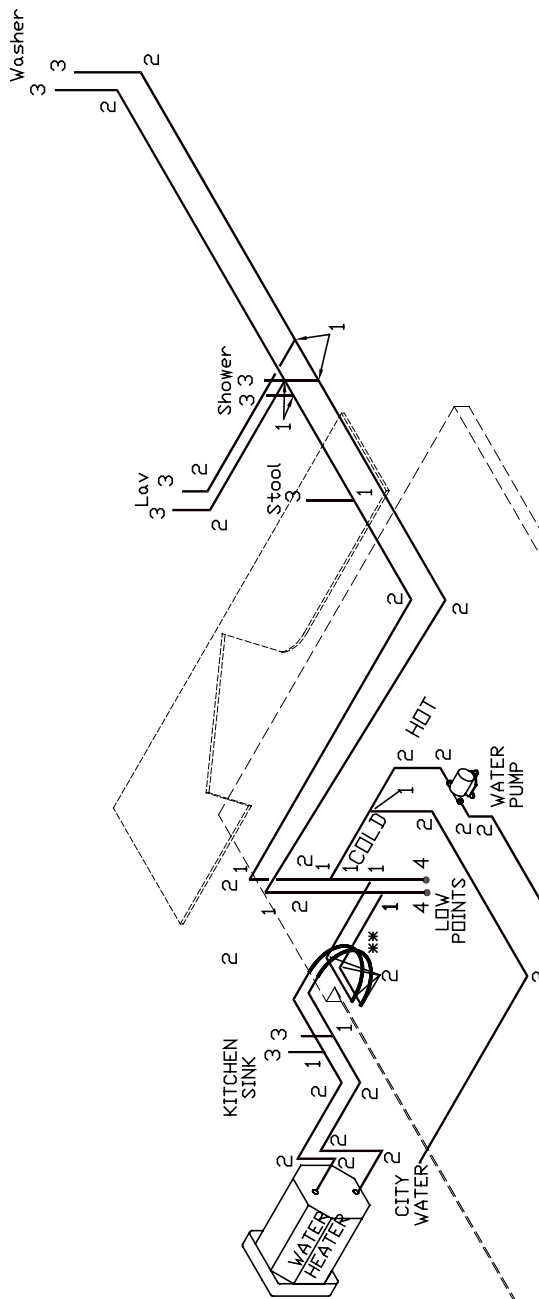

KEY	DESCRIPTION
1	1/2" Equal Radel Tee
2	1/2" Radel Elbow
3	1/2" Pex x 1/2" MNPT
4	1/2" Plastic Cap w/Seal

MAR CORP P.O. Box 30, Hee, IN. 46550 back--PB_TB-T4_09	Model: CPFW 35KSAH Title: WATER LINES	Sheet 2 OF 3	Drawn by: M. B.	Checked by: D. B.	Revision:
		I.D. # 2009/ TOW/COOP/PLUM/CPFW35KSAH	Date: 3/18/08	Date: 3/20/08	By: Date: