


ALL PIPE & FITTINGS ARE ABS SCHED. #40
ALL ELL'S ARE 90 LONG TURN UNLESS SPECIFIED
ALL MATERIALS USED IN THE DRAINAGE SYSTEM CONFORM TO NFPA 1192 7.11
DRAIN GRADE SET AT 1/8 INCH PER FOOT MINIMUM
DRAIN LINES ARE SUPPORTED AT A MAXIMUM INTERVAL OF 4 FEET
MAXIMUM TRAP ARM LENGTH IS 54"
ALL TRAPS ARE A MINIMUM REQUIRED SIZE OF 1 1/4"
ALL TANK HOOKUPS ARE A DOUBLE LTTY UNLESS SPECIFIED OTHERWISE
IN OR BELOW MAIN FLOOR
SEE WASHER TYPICAL FOR WASHER PLUMBING
TEI LISTED SWIVEL CONNECTIONS (LISTING #17062)
ALL TRAPS ARE REMOVABLE FOR USE AS A CLEANDOUT ACCESS
* - DENOTES 1 1/2" CAF- FLEX


SIZE OF TRAP ARM (IN.)	DISTANCE FROM TRAP TO VEN (FT.)
1 1/4	4 1/2
1 1/2	4 1/2
2	5
3	6

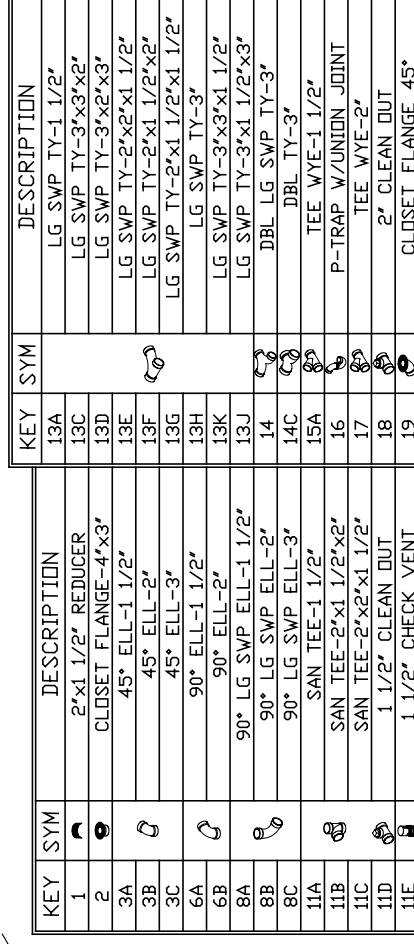

Model: DA DP 4085	Sheet 3 OF 3	Drawn by: S. W.	Checked by: J. B.	Revision:	By:
Title: DRAIN PLUMBING	I.D. # 2009\ DP\CODE\PLUM\DA\4085	Date: 3/27/08	Date: 4/8/08		
Title block-PB_TB-M9-pt_4					

NOTES:

SEE TYPICAL FOR WASHER INSTALLATION
ALL FRESH WATER LINES ARE 1/2" UPONDR PEX
DRAINS ARE INSTALLED AT LOW POINTS
BELOW MAIN FLOOR
TEI LISTED SWIVEL CONNECTIONS (LISTING #17062)
*-DENOTES 1/2" X 48" FAUCET RISER

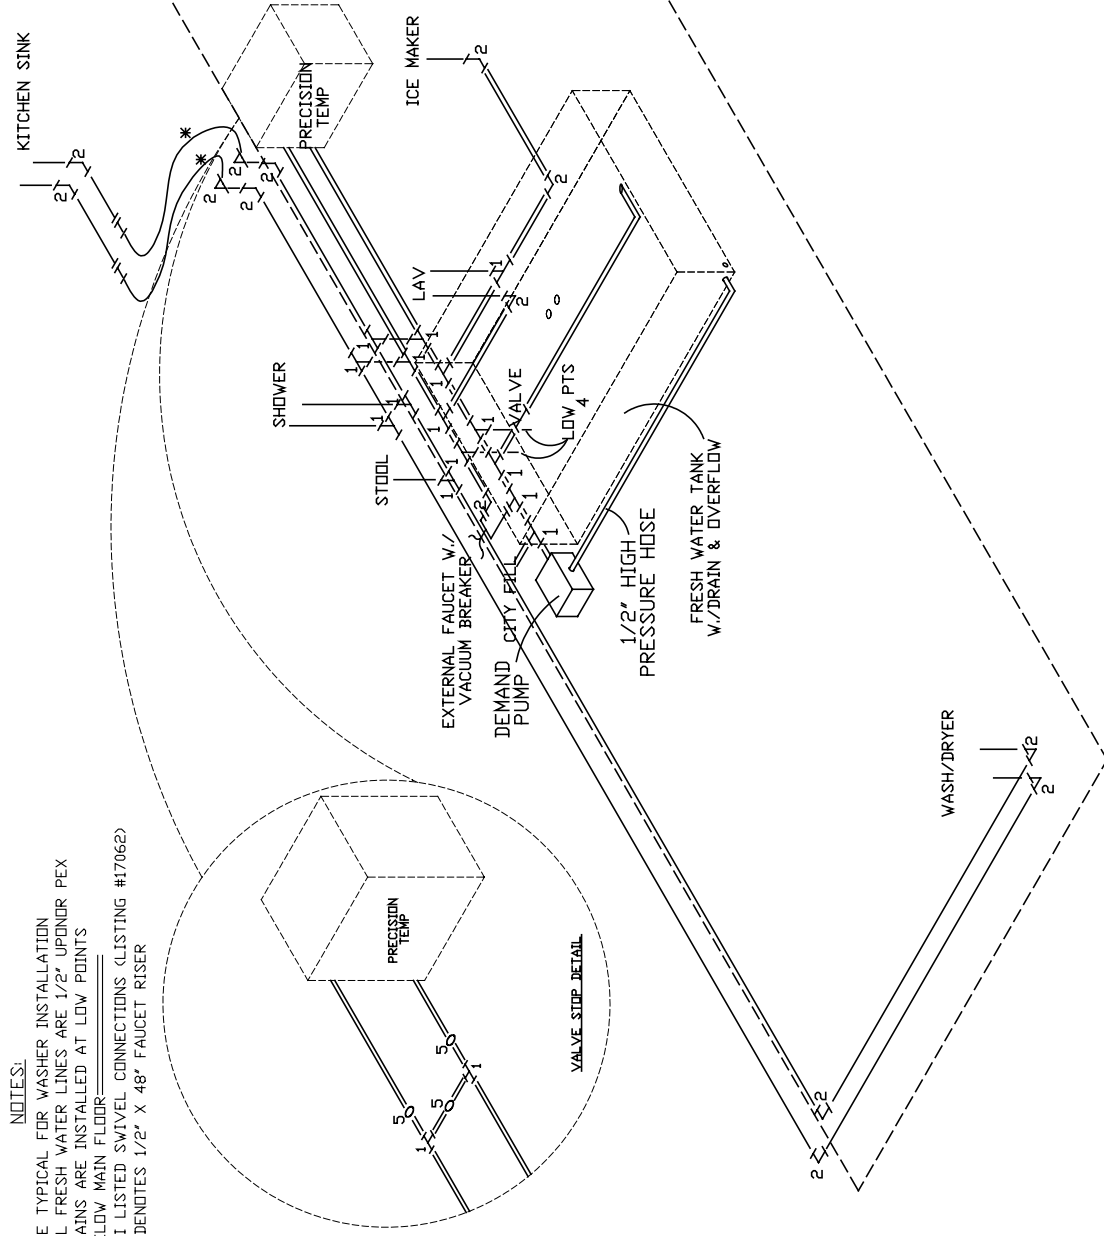

KEY	DESCRIPTION
1	1/2" EQUAL RADEL TEE
2	1/2" RADEL ELBOW
3	1/2" PEX x 1/2" MNPT
4	1/2" PLASTIC CAP W/ SEAL
5	PEX VALVE STOP 1/2" B X 1/2" B BLK

Model: DA DP 4085 Title: WATER LINES	Sheet 2 OF 3 I.D. # 2009\ DP\CODE\PLUM\DA\4085	Drawn by: S. W. Date: 3/27/08	Checked by: J. B. Date: 4/8/08	Revision: By: _____ Date: _____ By: _____ Date: _____
	Model: DA DP 4085 Title: WATER LINES	Sheet 2 OF 3 I.D. # 2009\ DP\CODE\PLUM\DA\4085	Drawn by: S. W. Date: 3/27/08	Checked by: J. B. Date: 4/8/08

NEWMAR CORP
 P.O. Box 30,
 Nappanee, IN. 46550
 Title block-PB_TB-M9-pt_4