



NOTES:

SEE TYPICAL FOR WASHER INSTALLATION
ALL FRESH WATER LINES ARE 1/2" UPONDR PEX
DRAINS ARE INSTALLED AT LOW POINTS
BELOW MAIN FLOOR
TEI LISTED SWIVEL CONNECTIONS (LISTING #17062)
*-DENOTES 1/2" X 48" FAUCET RISER

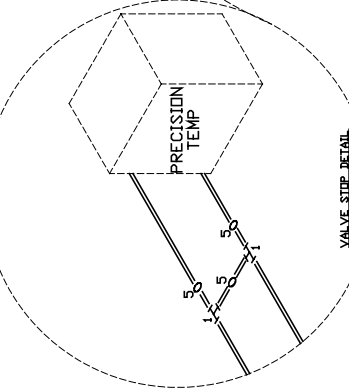

NOTE: SHUT OFF VALVES
FOR TAG AXLE UNITS IN
WATER WORKS COMPARTMENT

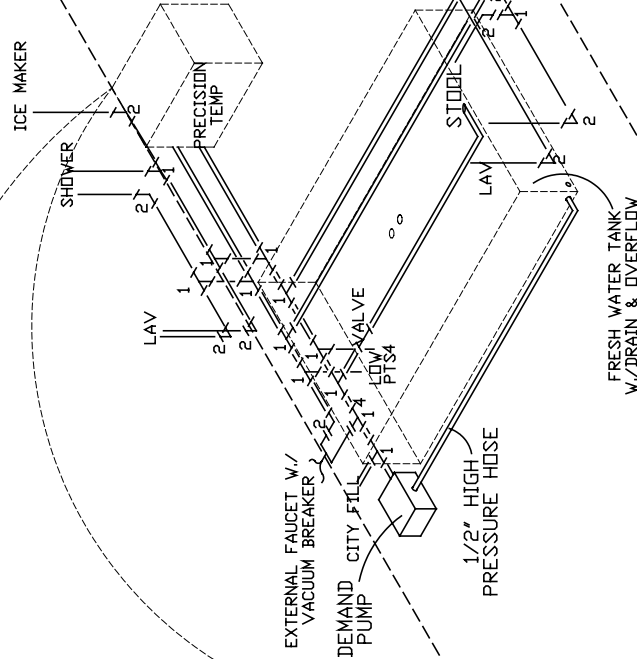

KEY	DESCRIPTION
1	1/2" EQUAL RADEL TEE
2	1/2" RADEL ELBOW
3	1/2" PEX x 1/2" MNPT
4	1/2" PLASTIC CAP W/ SEAL
5	PEX VALVE STOP 1/2" B X 1/2" B BLK

NEWMAR CORP P.O. Box 30, Nappanee, IN. 46550 Title block-PB_TB-M9-pt-4	Model: DA DP 4304	Sheet 2 OF 3	Drawn by: C. M.	Checked by: J. B.	Revision/CHANGED NOMENCLATURE REFERENCES FROM "DS" TO "DA", UPDATED By: R. G. F. ID# TO REFLECT NOMENCLATURE CHANGE.
	Title: WATER LINES	I.D. # 2009\ DP\CODE\PLUM\DA\4304	Date: 3/5/08	Date: 3/17/08	Date: 3/13/08

ALL PIPE & FITTINGS ARE ABS SCHED. #40
ALL ELL'S ARE 90 LONG TURN UNLESS SPECIFIED
ALL MATERIALS USED IN THE DRAINAGE SYSTEM CONFORM TO NFPA 1192 7.11
DRAIN GRADE SET AT 1/8 INCH PER FOOT MINIMUM
DRAIN LINES ARE SUPPORTED AT A MAXIMUM INTERVAL OF 4 FEET
MAXIMUM TRAP ARM LENGTH IS 54"
ALL TRAPS ARE A MINIMUM REQUIRED SIZE OF 1 1/4"
ALL TANK HOOKUPS ARE A DOUBLE LTTY UNLESS SPECIFIED OTHERWISE
IN OR BELOW MAIN FLOOR
SEE WASHER TYPICAL FOR WASHER PLUMBING
TEI LISTED SWIVEL CONNECTIONS (LISTING #17062)
ALL TRAPS ARE REMOVABLE FOR USE AS A CLEANDOUT ACCESS
* - DENOTES 1 1/2" CAF- FLEX

Model:	DA DP 4304	Sheet	3 OF 3	Drawn by:	C. M.	Checked by:	J. B.	Revised/CHANGED NOMENCLATURE REFERENCES FROM "DS" TO "DA", UPDATE	By: R. G. F.
Title:	DRAIN PLUMBING	I.D. # 2009N		Date:	3/5/08	Date:	3/17/08	ID# TO REFLECT NOMENCLATURE CHANGE.	Date:3/13/08
Title block-PB_TB-M9-pt_4		DPA CODE \PLUM\DA\4304							