


SIZE OF TRAP ARM (IN)	DISTANCE FROM TRAP TO VENT (FT)
1 1/4	4 1/2
1 1/2	4 1/2
2	5
3	6

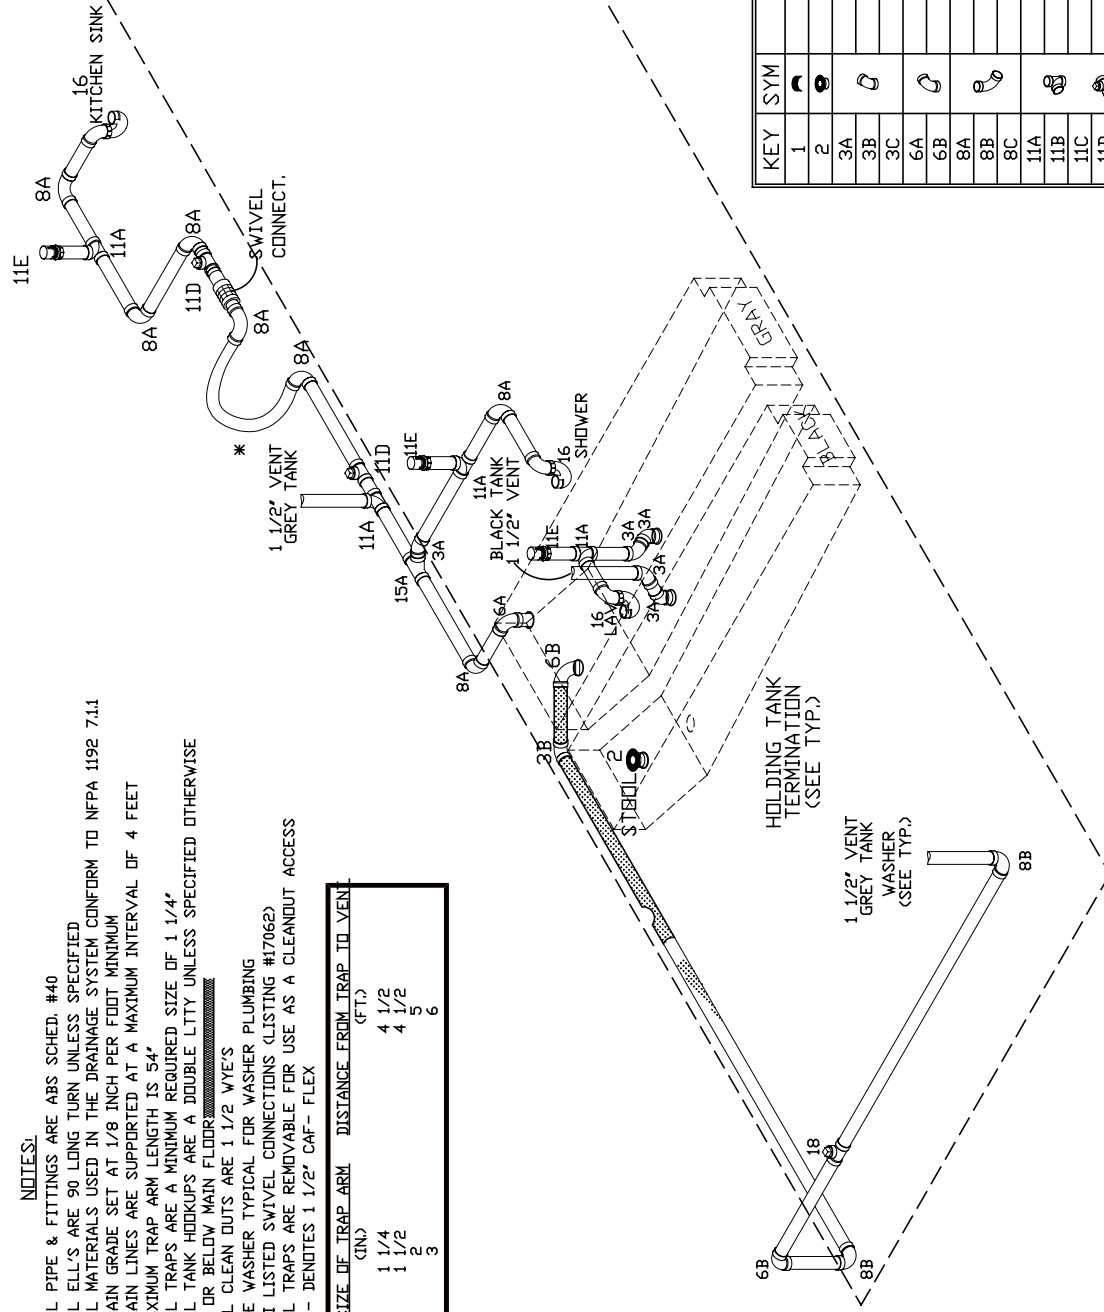


KEY	SYM	DESCRIPTION	KEY	SYM	DESCRIPTION
1		2"x1 1/2" REDUCER	13A		LG SWP TY-1 1/2"
2		CLOSED FLANGE-4"x3'	13C		LG SWP TY-3"x3"x2"
3A		45° ELL-1 1/2'	13D		LG SWP TY-3"x2"x3'
3B		45° ELL-2'	13E		LG SWP TY-2"x2"x1 1/2'
3C		45° ELL-3'	13F		LG SWP TY-2"x1 1/2"x2"
6A		90° ELL-1 1/2'	13G		LG SWP TY-2"x1 1/2"x1 1/2'
6B		90° ELL-2'	13H		LG SWP TY-3'
8A		90° LG SWP ELL-1 1/2"	13K		LG SWP TY-3"x3"x1 1/2'
8B		90° LG SWP ELL-2'	13J		LG SWP TY-3"x1 1/2"x3'
8C		90° LG SWP ELL-3'	14		DBL LG SWP TY-3'
11A		SAN TEE-1 1/2'	14C		DBL TY-3'
11B		SAN TEE-2"x1 1/2"x2'	15A		TEE WYE-1 1/2'
11C		SAN TEE-2"x2"x1 1/2'	16		P-TRAP W/UNION JOINT
11D		1 1/2" CLEAN OUT	17		TEE WYE-2'
11E		1 1/2" CHECK VALVE	18		2" CLEAN OUT
			19		CLOSED FLANGE 45°

Model:	Sheet	Drawn by:	Checked by:	By:
NEWMAR CORP P.O. Box 30, Nappanee, IN. 46550	3 OF 3	N. G.	J. B.	
Title:	I.D. #	Date:	Date:	Date:
DRAIN PLUMBING	2009\DP\CODE\PLUM\DS\4086	3/17/08	3/18/08	
Title block-PB-TB-M9-A				Date:

NOTES:

SEE TYPICAL FOR WASHER INSTALLATION
ALL FRESH WATER LINES ARE 1/2" UPONDR PEX
DRAINS ARE INSTALLED AT LOW POINTS
BELOW MAIN FLOOR
TEI LISTED SWIVEL CONNECTIONS (LISTING #17062)
*-DENOTES 1/2" X 48" FAUCET RISER

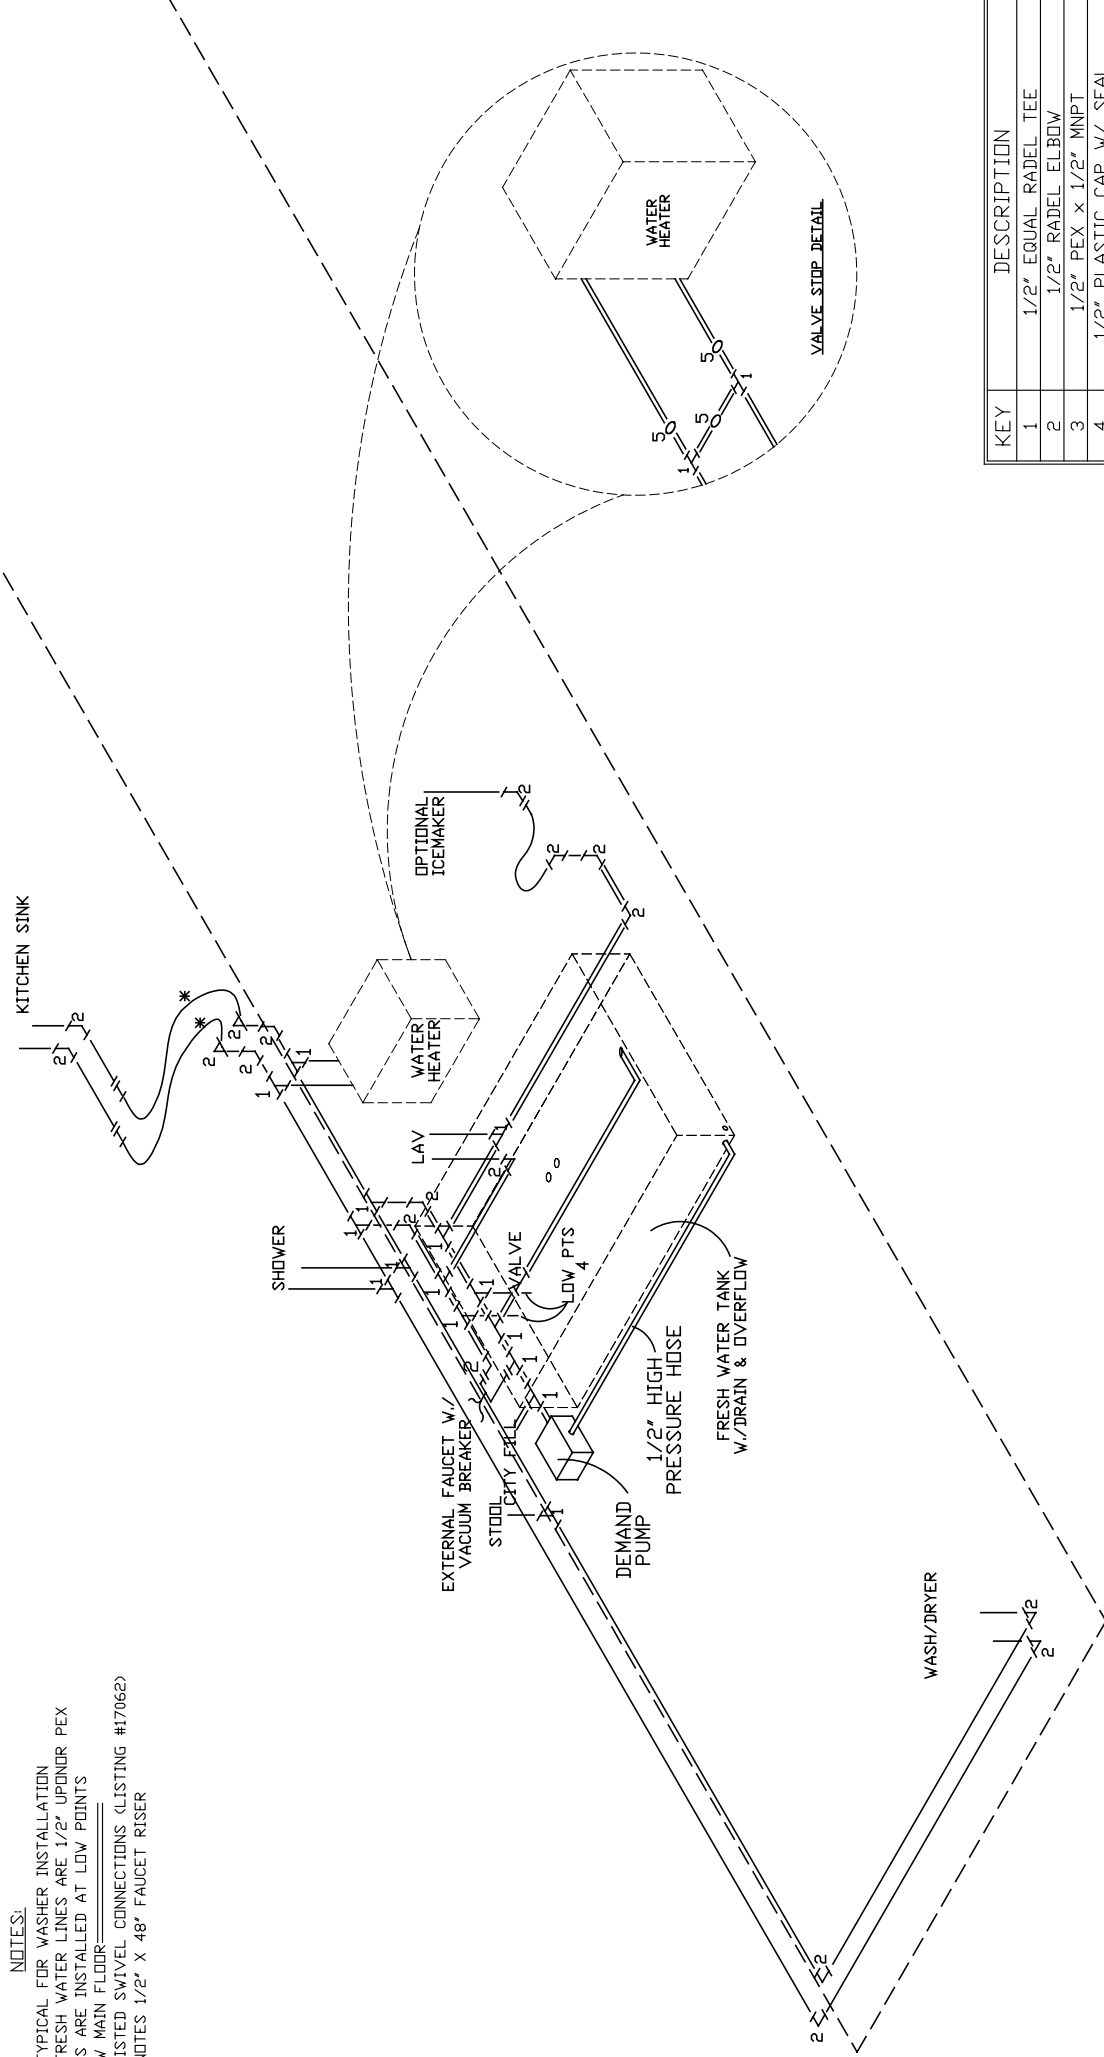

KEY	DESCRIPTION
1	1/2" EQUAL RADEL TEE
2	1/2" RADEL ELBOW
3	1/2" PEX x 1/2" MNPT
4	1/2" PLASTIC CAP W/ SEAL
5	PEX VALVE STOP 1/2" B X 1/2" B BLK

Revision	WATER LINE ADDED FOR OPTIONAL ICEMAKER PER ECO #137 (PCR #87483)	By: R.N.
Date	4/15/08	By:
By:	J. B.	Date:
Date:	3/18/08	Date:

Sheet	2 OF 3	Drawn by:	N. G.	Checked by:	J. B.
I.D. #	2009\DP\CODE\PLUM\DS\4086	Date:	3/17/08	Date:	3/18/08

Model:	DS DP 4086	Title:	WATER LINES
Title block-PB_TB-M9_A			