


NOTES:

SEE TYPICAL FOR WASHER INSTALLATION
ALL FRESH WATER LINES ARE 1/2" UPONOR PEX
DRAINS ARE INSTALLED AT LOW POINTS
IN OR BELOW MAIN FLOOR
TEI LISTED SWIVEL CONNECTIONS (LISTING #17062)
*-DENOTES 1/2" X 48" FAUCET RISER

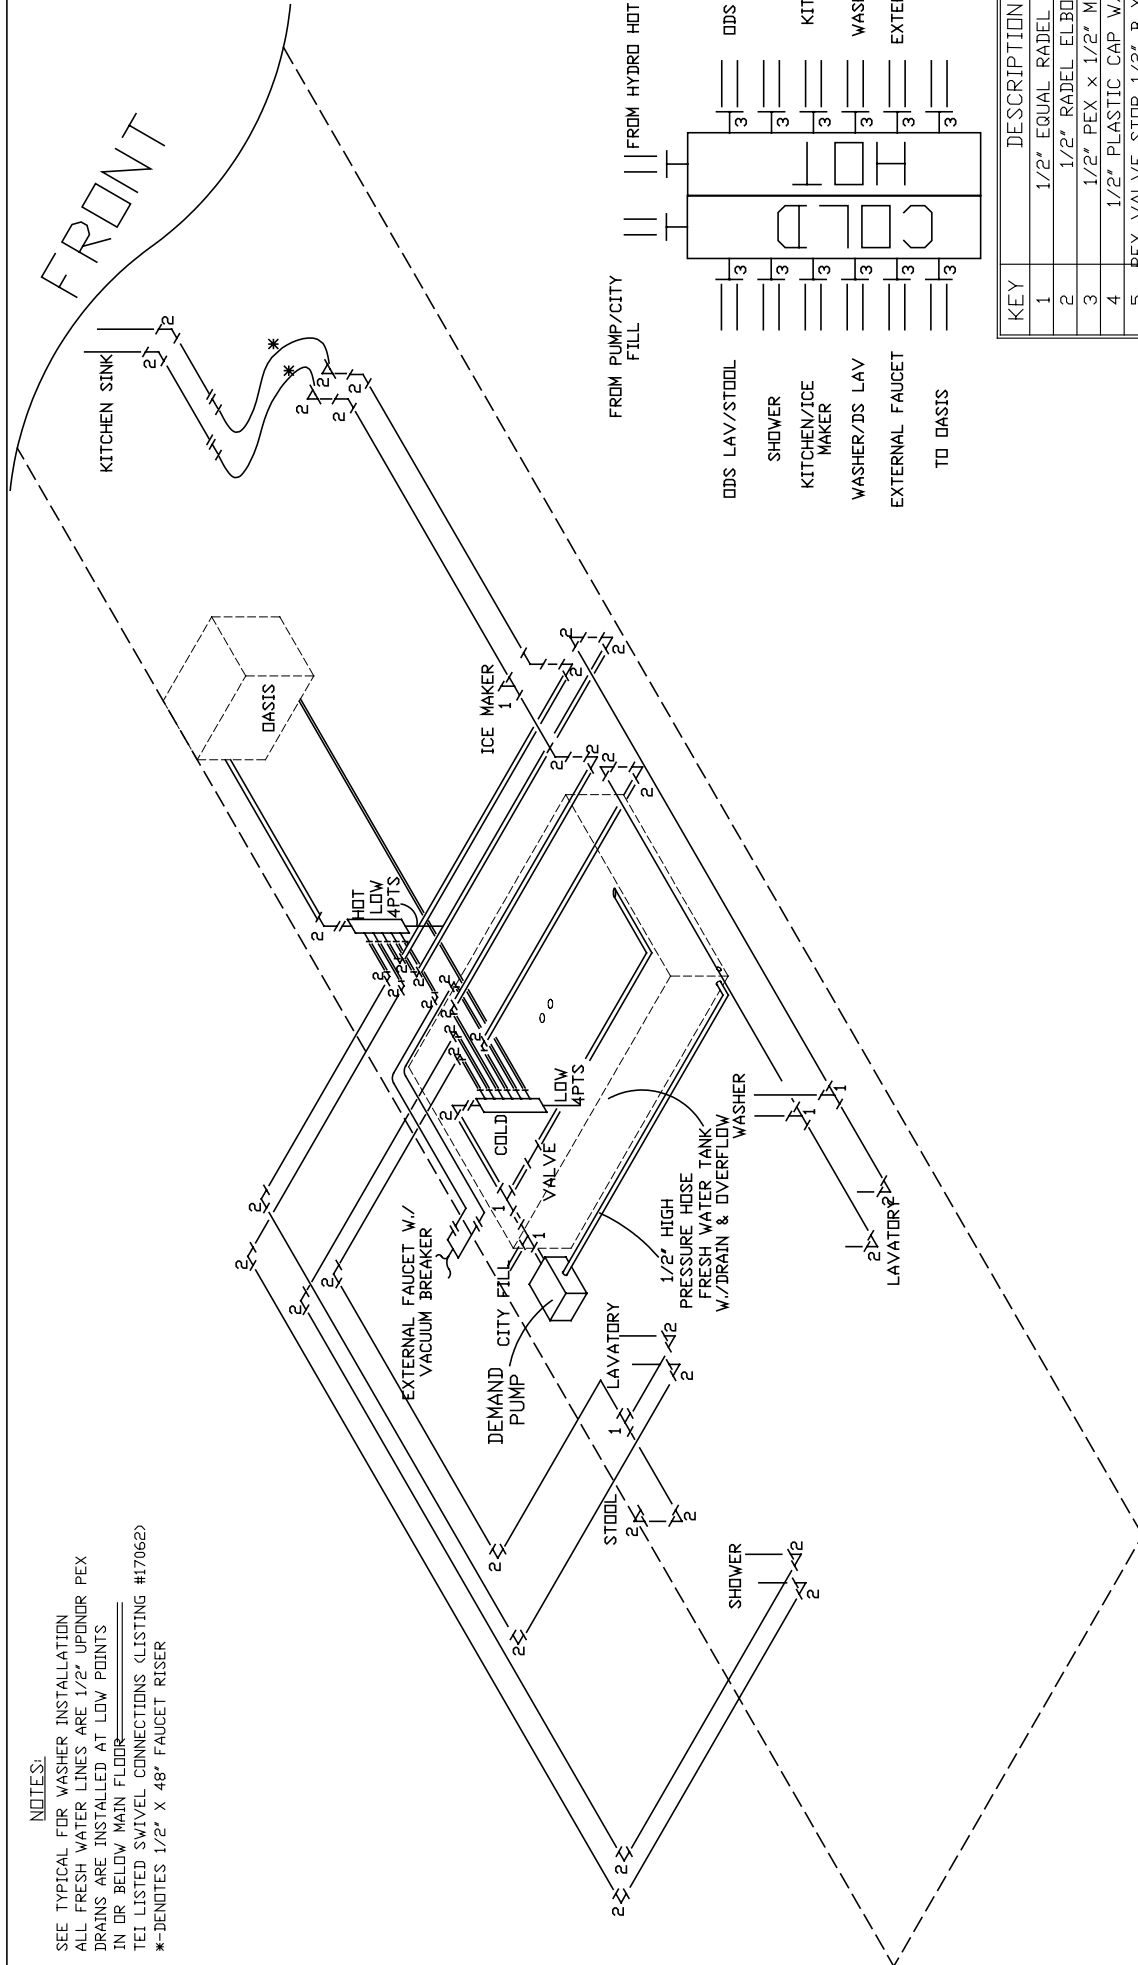

KEY	DESCRIPTION
1	1/2" EQUAL RADEL TEE
2	1/2" RADEL ELBOW
3	1/2" PEX x 1/2" MNPT
4	1/2" PLASTIC CAP W/SEAL
5	PEX VALVE STOP 1/2" B X 1/2" B BLK

NEWMAR CORP P.O. Box 30, Nappanee, IN. 46550 Title block-PB_TB-M9_HE	Model: EX DP 4502	Sheet 2 DF 3	Drawn by: N. G.	Checked by: B. G.	Revision:
	Title: WATER LINES	I.D. # 2009\HE\CODE\PLUM\EX\4502	Date: 8/15/07	Date: 10/4/07	By: Date: By: Date:

ALL PIPE & FITTINGS ARE ABS SCHED. #40
ALL MATERIALS USED IN THE DRAINAGE SYSTEM CONFORM TO NFPA 1192 7.1.1
DRAIN GRADE SET AT 1/8 INCH PER FOOT MINIMUM
DRAIN LINES ARE SUPPORTED AT A MAXIMUM INTERVAL OF 4 FEET
ALL TANK HOOK-UPS ARE A DOUBLE LTTY UNLESS SPECIFIED OTHERWISE
IN OR BELOW MAIN FLOOR
SEE WASHER TYPICAL FOR WASHER PLUMBING
SEE HOLDING TANK TYPICAL FOR TERMINATION PLUMBING
TEL LISTED SWIVEL CONNECTIONS (LISTING #17062)
ALL TRAPS ARE REMOVABLE FOR USE AS A CLEANDOUT ACCESS
* - DENOTES 1 1/2" CAF- FLEX

Model:	EX DP 4502	Sheet	3 OF 3	Drawn by:	N. G.	Checked by:	B. G.	Revisions:	By:
Title:	DRAIN PLUMBING	I.D. # 2009\HCODE\PLUM\EX\4502		Date:	8/15/07	Date:	10/4/07		Date:
NEWMAR CORP P.O. Box 30, Nappanee, IN. 46550									
title block-PB-TB-M9_HE									

Sheet 3 OF 3	Drawn by: N. G.	Checked by: B. G.
I.D. # 2009\HEXCODE\PLUM\EX\4502	Date: 8/15/07	Date: 10/4/07

Model:	EX DP 4502
Title:	DRAIN PLUMBING