


ELECTRICAL SYMBOLS

0000 COMPLEXION LIGHT	Ⓢ COURTESY LIGHT	Ⓡ 12V RANGE HOOD
16W FLUORESCENT LIGHT	Ⓢ HALOGEN LIGHT	Ⓡ 6V VOLT CHASSIS BATTERY
30W FLUORESCENT LIGHT	Ⓢ DIRECTIONAL LIGHT	Ⓡ 12V STORAGE BATTERY
SINGLE INCANDESCENT LIGHT	Ⓢ 12V SWITCH	Ⓡ 12V FAN VENT
AUTOMATIC INCANDESCENT LIGHT	Ⓢ 12V DISTRIBUTION PANEL	Ⓡ FURNACE
12V DINETTE LIGHT	Ⓢ WATER HEATER	Ⓡ THERMOSTAT
12V J-LIGHT (Wall Light)	Ⓢ CONVERTER	Ⓡ THERMOSTAT SENSOR
12V MAP LIGHT (Wall Light)	Ⓢ AQUA-HOT SYSTEM	Ⓡ CO DETECTOR
DOUBLE INCANDESCENT LIGHT	Ⓢ HYDRO-HOT SYSTEM	Ⓡ T.V. ANTENNA BOOSTER
SECURITY LIGHT	Ⓢ AIR CONDITIONER	Ⓡ PROPANE DETECTOR
MOOD LIGHT	Ⓢ MONITOR PANEL	Ⓡ 12V RECEPT
LAMBREQUIN LIGHT	Ⓢ WATER PUMP	Ⓡ MASTER SWITCH FOR STORAGE LIGHTS
S-O SWITCH	Ⓢ SUB WOOFER	Ⓡ PHONE JACK
S-O ACTIVATOR SWITCH		Ⓡ POWER LOCK ARMS

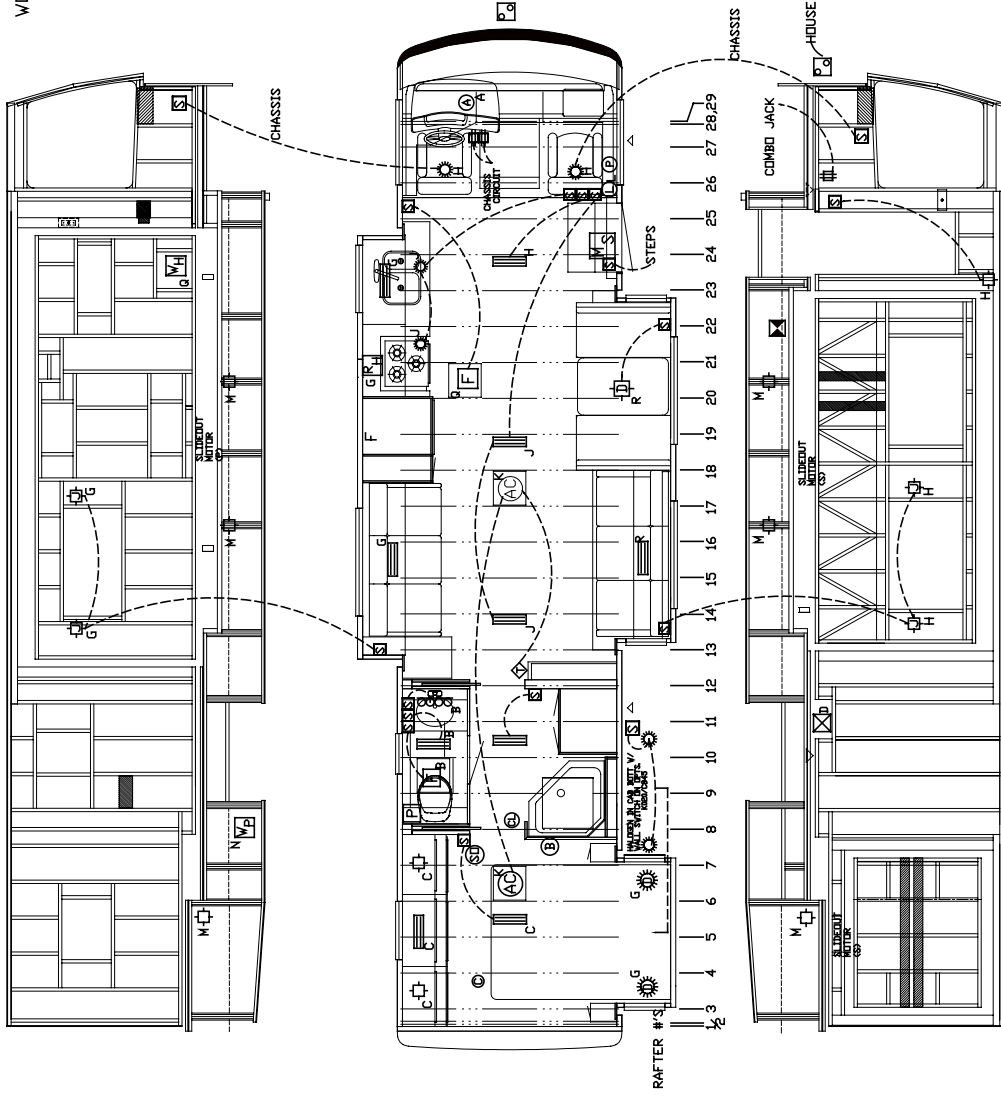

NOTE: ALL COURTESY LIGHTS TIED TO CHASSIS CIRCUIT

CIRCUIT	WIRE SIZE	VOLTS	FUSE BREAKER	LOAD
A	# 12 STRANDED	12	20 AMP	TV/STEREO
B	# 10 STRANDED	12	20 AMP	BATHROOM
C	# 10 STRANDED	12	20 AMP	BEDROOM
D	# 12 STRANDED	12	20 AMP	FURNACE
E	# 12 STRANDED	12	20 AMP	SECURITY / OPEN
F	# 12 STRANDED	12	5 AMP	REFRIGERATOR / OPEN
G	# 12 STRANDED	12	20 AMP	DDS SLIDE-OUT LIGHTS
H	# 10 STRANDED	12	20 AMP	LIVING ROOM
J	# 10 STRANDED	12	20 AMP	KITCHEN
K	# 16 STRANDED	12	7.5 AMP	A/C
L	# 16 STRANDED	12	1 AMP	PROPANE DETECTOR
M	# 12 STRANDED	12	20 AMP	STORAGE LIGHTS
N	# 12 STRANDED	12	20 AMP	MONITOR PAN/WATER PUMP
P	# 12 STRANDED	12	20 AMP	DDS SLIDE-OUT MOTOR
Q	# 12 STRANDED	12	7.5 AMP	FAN/ VENT/WATER HTR
R	# 12 STRANDED	12	20 AMP	DS SLIDE-OUT LIGHTS
S	# 12 STRANDED	12	20 AMP	DS SLIDE-OUT MOTOR

Revision	WALL MOUNTED READING LIGHT LOCATED ON FRONT DS AND DDS SIDEWALL REMOVED	R. R.
W/ OPT. K020	REPLACED WITH A CEILING MOUNTED HALOGEN LIGHT ABOVE DRIVER AND PASSENGER SEAT PER ECO	R. R.
Revision	ADD OPTION C845 (ECO #312)	R. R.
Date	9/6/07	

Model	GS CA 3752 (K020) (C845)	Sheet	1 OF 3	Drawn by	C. L.	Checked by	R. R.
Title	12V WIRING DIAGRAM	I.D. #	2009\CA\CODE\VELEC\GS\3752	Date	8/24/07	Date	9/6/07
Title block: EL_TB-M-08							

FLUORESCENT ILO INCANDESCENT (ECO #43), HALOGEN ILO DIRECTIONAL R. R.
W/ OPT. K020 (ECO #24)
MOVE THERMOSTAT AWAY FROM DOOR TO DRY BAR SIDE
3/20/08
R. R.
12/24/07