

NOTES:

Maximum developed length - 70'

1/2" Black mall pipe

3/8" I.D. copper type "L"


Max. length of copper type to appliance per test

Propane Distribution System Complies With The Parameters Set By RVIA Test By Table 5.3.4 (NFPA 1192)

All brass fittings below floor to be forged--not milled

Maximum developed length of flex hose - 72"

MAX BTU VALUES	
FURNACE	40,000
RANGE	29,800
REFRIGERATOR	1,500
WATER HEATER	12,000
TOTAL BTU	85,300

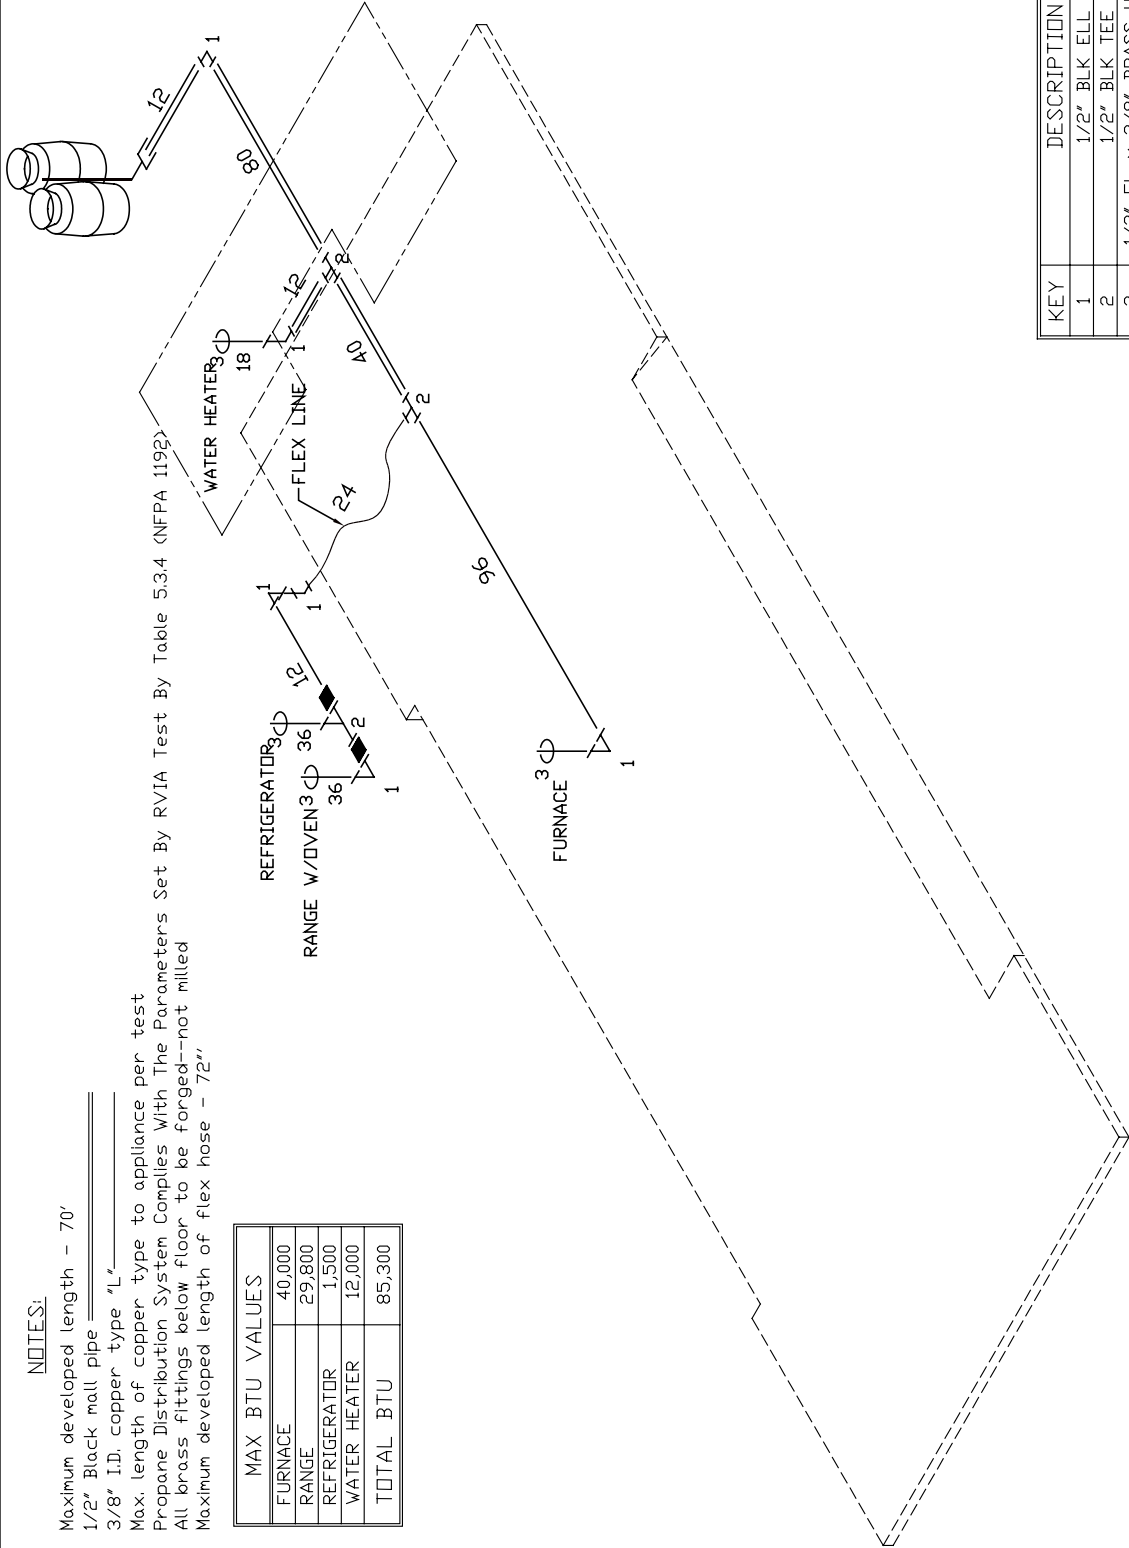


KEY	DESCRIPTION
1	1/2" BLK ELL
2	1/2" BLK TEE
3	1/2" FL x 3/8" BRASS UNION MPT

Revision/REV	MAX BTU FOR FURNACE TO 40000	ILD 42000	ECO #728	By: M.B.
Date:	9/9/08			
By:				
Date:				

Sheet	3	DF	3	Drawn by:	T. M.	Checked by:	D. B.
I.D. #	2009/			Date:	9/18/07	Date:	10/16/07
TOW/CODE	PLUM/KAF37RLCS						

Model:	KAFW 37RLCS		
Title:	PROPANE GAS		
NEWMAR CORP			
P.O. Box 30,			
Nappanee, IN, 46550			
Title block--PB_TB-T4_08			

Mounting Clamp



- Rubber Coated Steel Clamp Used To Secure Gas Manifold
- Plastic Clamp Used To Secure Copper Tubing
- Grommets Used To Protect Copper Through Floors, Walls, Cab. Partitions Etc.