

ELECTRICAL SYMBOLS

WORKING CLEARANCE MIN. 24Vx22D

 POWER CORD

 100V JUNCTION BOX

 INVERTER/CONVERTER

 120vac BREAKER BOX

 120vac BREAKER BOX (CANADA)

 DASIS-HOT SYSTEM

 AIR CONDITIONER

 MONITOR PANEL

 100V LIGHT

 120vac DIMETTE LIGHT

 100V SWITCH

 100V RECEPT

 CMP. GFI BREAKER & RECEPT

 T.V.

 STEREO



NOTES:

30A CIRCUITS WIRED W/10-2 RDMEX TYPE NM-B.
20A CIRCUITS WIRED W/12-2 RDMEX TYPE NM-B.
15A CIRCUITS WIRED W/14-2 RDMEX TYPE NM-B.
ALL PRE-WIRE FOR AIR USE 20 AMP FUSE AT BREAKER BOX.
DISTRIBUTION PANEL EXPOSED TO AISLE SPACE.


SOME CIRCUITS MAY NOT APPLY TO
CERTAIN BRAND AND TYPE UNITS.

CIRCUIT	FUSE	BREAKER	LOAD
1	20 Amp HACR	Front air conditioner	
3A	20 Amp HACR	Basin	
3B	20 Amp HACR	Basin	
6	20 Amp HACR	Rear air conditioner	
7	20 Amp HACR	Center air conditioner	
8	20 Amp HACR	Dryer	
9	15 Amp HACR	Washer	
10	15 Amp HACR	Block heater	
11	15 Amp HACR	Heat pads	
13	15 Amp HACR	Freezer	
14	15 Amp HACR	Wash/dry combo	
15	20 Amp HACR	Inverter/Converter - subpanel	
16	15 Amp HACR	Refr	
CIRCUIT	FUSE	BREAKER	LOAD
2	20 Amp HACR	Microwave	
4	20 Amp HACR	Lights/General recepts	
5	20 Amp HACR	Kitchen recept(s)	
12	20 Amp HACR	Kitchen recept	

50 Amp Service
w/ Inv
and
Subpanel

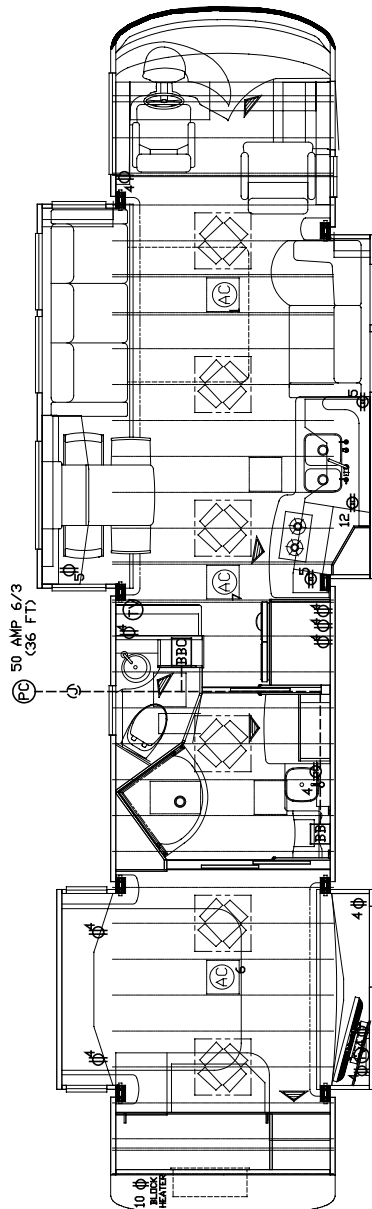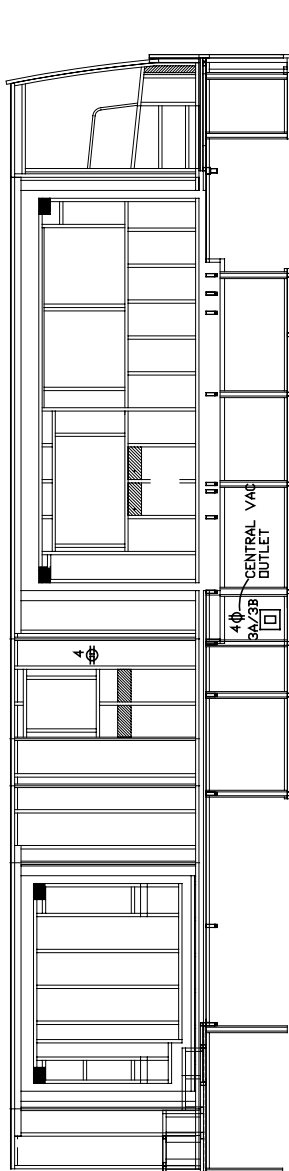

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30
RAFTER #'S

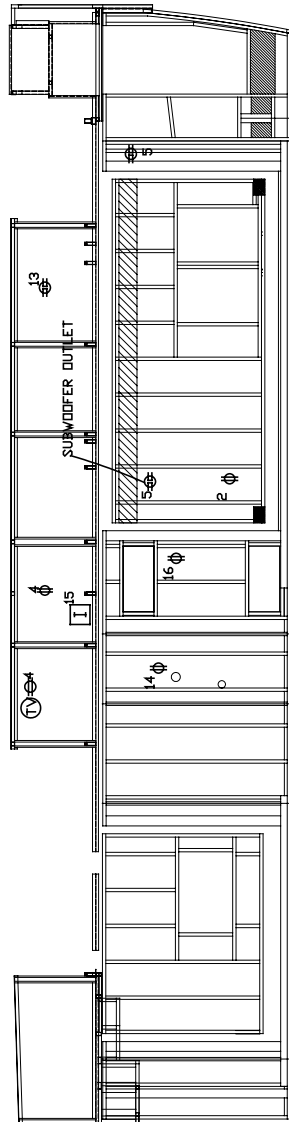

Model: NEWMAR CORP P.O. Box 30, Nappanee, IN. 46550 Title block-EL_TB-W-09_KGDB	Model: KG DB 4560	Sheet 1 OF 4 I.D. # 2009\HE\CODE\ELEC\KG\4560	Drawn by: N. G. Date: 8/14/07	Checked by: B. G. Date: 9/13/07	Revision:
					Date: 1/16/08