


NOTES:

Maximum developed length - 70'


1/2" Black mall pipe  
3/8" I.D. copper type "L"

Max. length of copper type to appliance per test  
Propane Distribution System Complies With The Parameters Set By Table 5.3.4 (NFPA 1192)  
All brass fittings below floor to be forged--not milled  
Maximum developed length of flex hose - 72"

| MAX BTU VALUES |        |
|----------------|--------|
| FURNACE        | 40,000 |
| RANGE          | 29,800 |
| REFRIGERATOR   | 1,500  |
| WATER HEATER   | 12,000 |
| TOTAL BTU      | 85,300 |

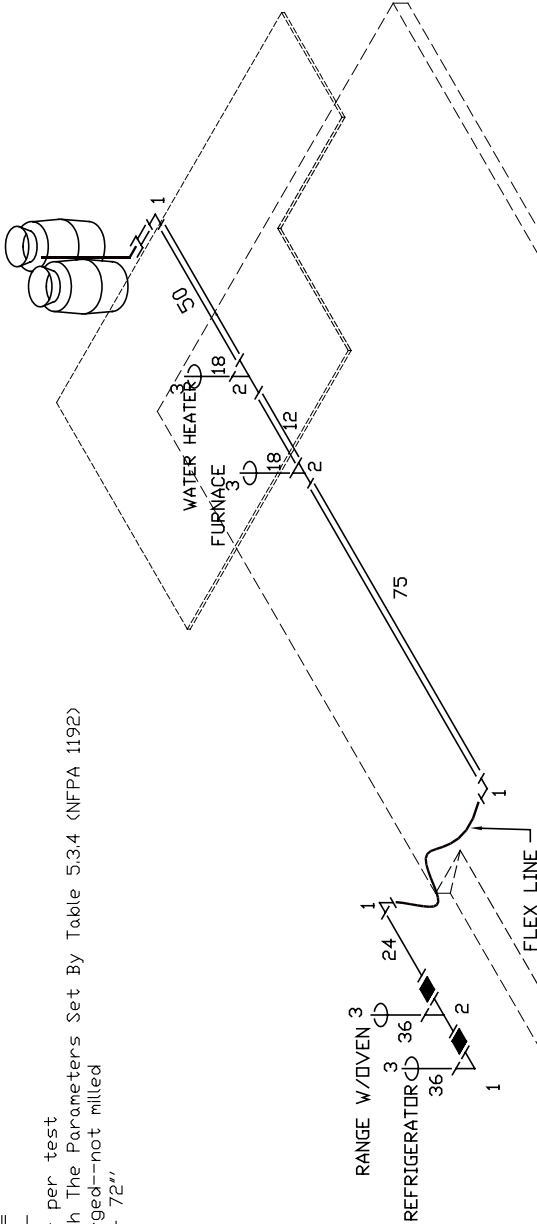

Mounting Clamp



-Rubber Coated Steel Clamp Used To Secure Gas Manifold

-Plastic Clamp Used To Secure Copper Tubing

-Grommets Used To Protect Copper Through Floors, Walls, Cab. Partitions Etc.

| KEY | DESCRIPTION                    |
|-----|--------------------------------|
| 1   | 1/2" BLK ELL                   |
| 2   | 1/2" BLK TEE                   |
| 3   | 1/2" FL x 3/8" BRASS UNION MPT |

|                                                                                |        |             |        |        |           |        |             |         |
|--------------------------------------------------------------------------------|--------|-------------|--------|--------|-----------|--------|-------------|---------|
| NEWMAR CORP<br>P.O. Box 30,<br>Nappanee, IN. 46550<br>Title block--PB_TB-T4_09 | Model: | TPFW 37LKSB | Sheet  | 3 OF 3 | Drawn by: | T. M.  | Checked by: | D. B.   |
|                                                                                | Title: | PROPANE GAS | I.D. # | 2009/  | Date:     | 4/7/08 | Date:       | 4/11/08 |

|           |                                                       |       |          |
|-----------|-------------------------------------------------------|-------|----------|
| Revision: | REMOVED "BY RVIA TEST" IN NOTES                       | By:   | M.B.     |
| Revision: | REV MAX BTU FOR FURNACE TO 40000 ILD 42000 (ECD #728) | Date: | 10/21/08 |
| Revision: |                                                       | By:   | M.B.     |
| Revision: |                                                       | Date: | 9/9/08   |

REV WATER HEATER RISER LOCATION PER (PCR #87467) M.B.

6/11/08  
T.M.  
1/24/07  
CHANGED BTU RATING OF REFER TO 1,500 AND  
TOTAL TO 85,300 (PCR #85054)