

NOTES:

Maximum developed length - 70'

1/2" Black mall pipe

3/8" I.D. copper type "L"


Max. length of copper type to appliance per test

Propane Distribution System Complies With The Parameters Set By Table 5.3.4 (NFPA 1192)

All brass fittings below floor to be forged--not milled

Maximum developed length of flex hose - 72"

MAX BTU VALUES	
FURNACE	40,000
RANGE	29,800
REFRIGERATOR	1,500
WATER HEATER	12,000
TOTAL BTU	85,300

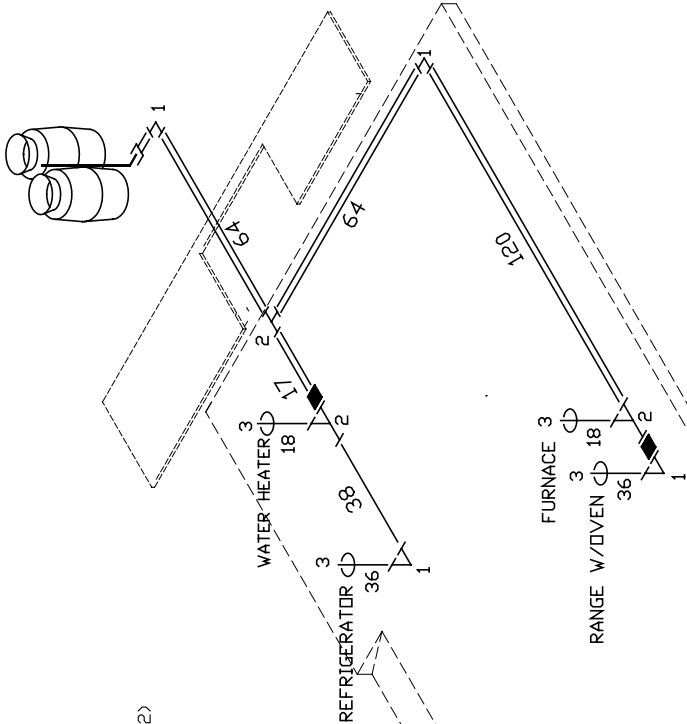

NEWMAR CORP P.O. Box 30, Nappanee, IN. 46550		Model: TPFW 39QSRL		Sheet 3 OF 3		Drawn by: T. M.		Checked by: D. B.		Revision: REMOVED "BY RVIA TEST" IN NOTES (PCR #87633)		By: M.B.	
Title: PROPANE GAS		I.D. # 2009/ TOW/CODE/PLUM/PP/FV39QSRL		Date: 4/14/08		Date: 4/18/08		Date: 4/18/08		Revision: REV MAX BTU FOR FURNACE TO 40000 ILD 42000 (ECD #728)		Date: 10/21/08	
Title block--PB_TB-T4_09												Date: 9/9/08	

KEY	DESCRIPTION
1	1/2" BLK ELL
2	1/2" BLK TEE
3	1/2" FL x 3/8" BRASS UNION MPT

Mounting Clamp

-Rubber Coated Steel Clamp Used To Secure Gas Manifold

-Plastic Clamp Used To Secure Copper Tubing

-Grommets Used To Protect Copper Through Floors, Walls, Cab. Partitions Etc.