


NOTES:

All fresh water lines on Aires are 1/2" TuffPex-A
All fresh water lines on Stars are 1/2" TuffPex-A
Drains are installed at low points
TEI listed swivel connections (listing #17062)
**-Denotes 1/2" x 48" Faucet riser
Install 18" high pressure hose at pump discharge

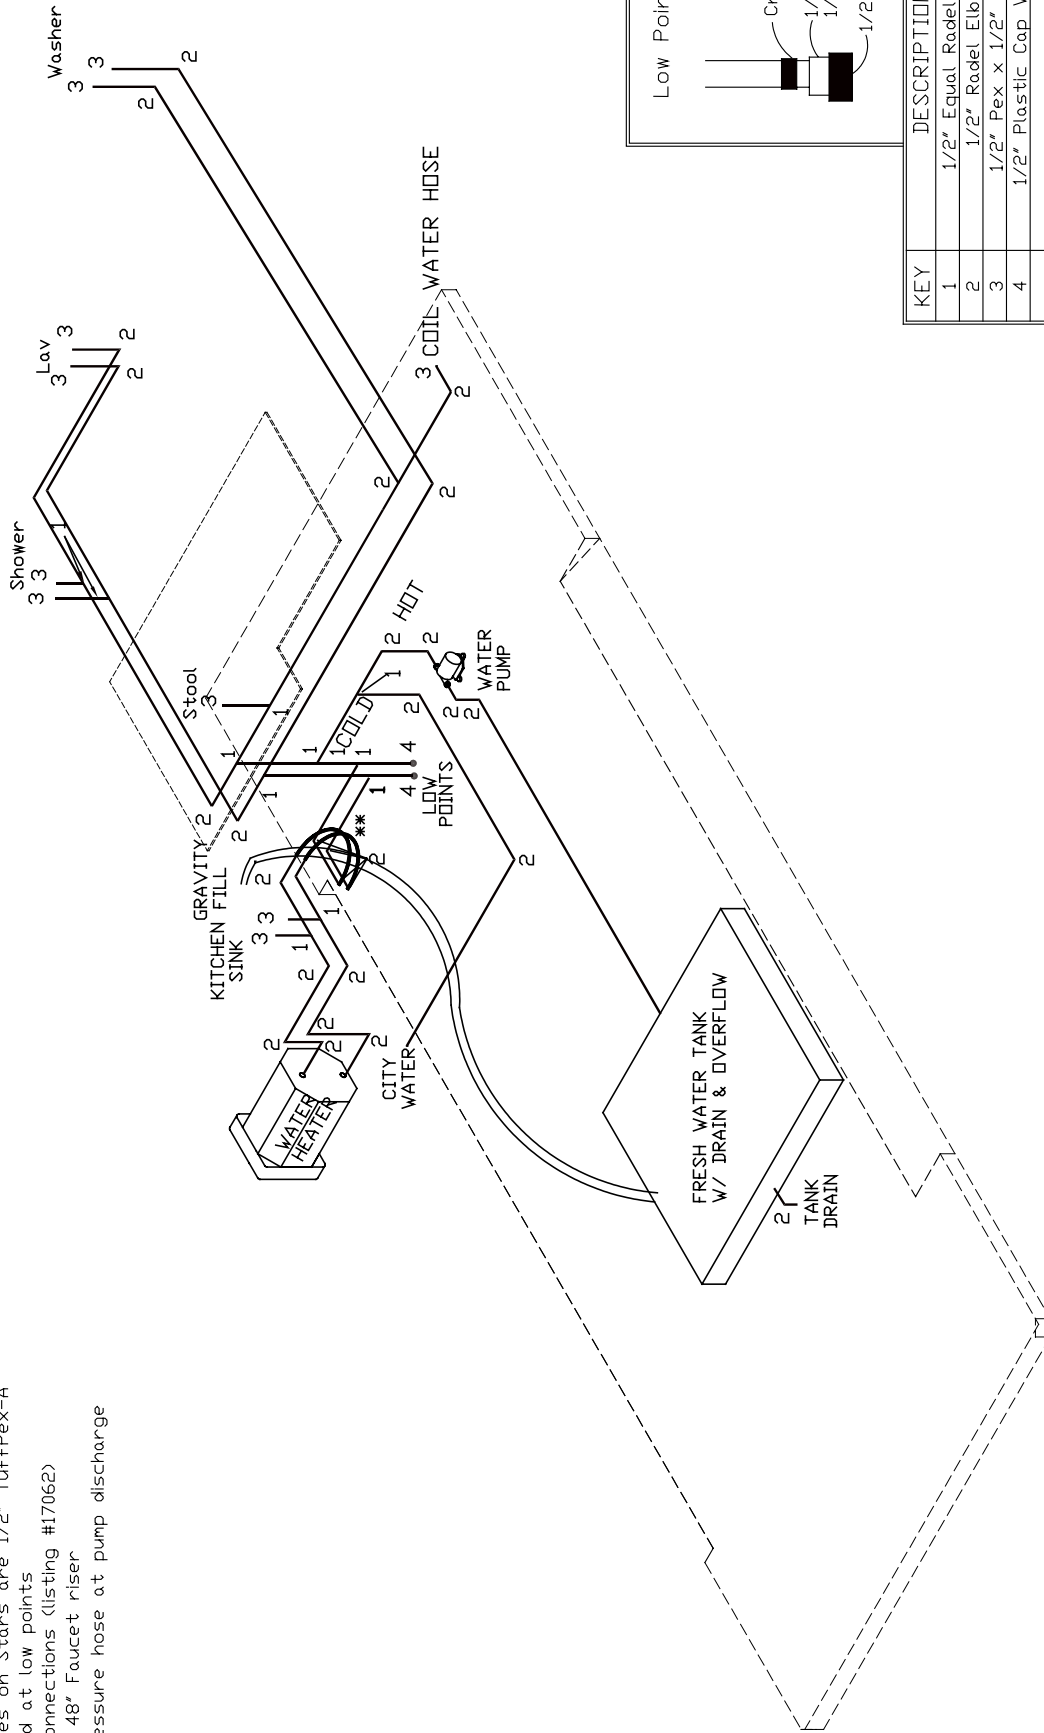

KEY	DESCRIPTION
1	1/2" Equal Radel Tee
2	1/2" Radel Elbow
3	1/2" Pex x 1/2" MNPT
4	1/2" Plastic Cap W/Seal

NEWMAR CORP P.O. Box 30, Nappanee, IN. 46550 Title block--PB_TB-T4_09	Model: TPFW 35KSLR	Sheet 2 OF 3	Drawn by: T. M.	Checked by: D. B.	Revision:	
					By:	Date:
	Title: WATER LINES	I.D. # 2009/ TOW/CODE/PLUM/PP/FV35KSLR	Date: 3/4/08	Date: 3/10/08	Revision:	
					By:	Date:

NOTES:

Maximum developed length - 70'

1/2" Black malleable pipe

3/8" I.D. copper type "L"


Max. length of copper type to appliance per test

Propane Distribution System Complies With The Parameters Set By Table 5.3.4 (NFPA 1192)


All brass fittings below floor to be forged--not milled

Maximum developed length of flex hose - 72"

MAX BTU VALUES	
FURNACE	40,000
RANGE	29,800
REFRIGERATOR	1,500
WATER HEATER	12,000
TOTAL BTU	85,300

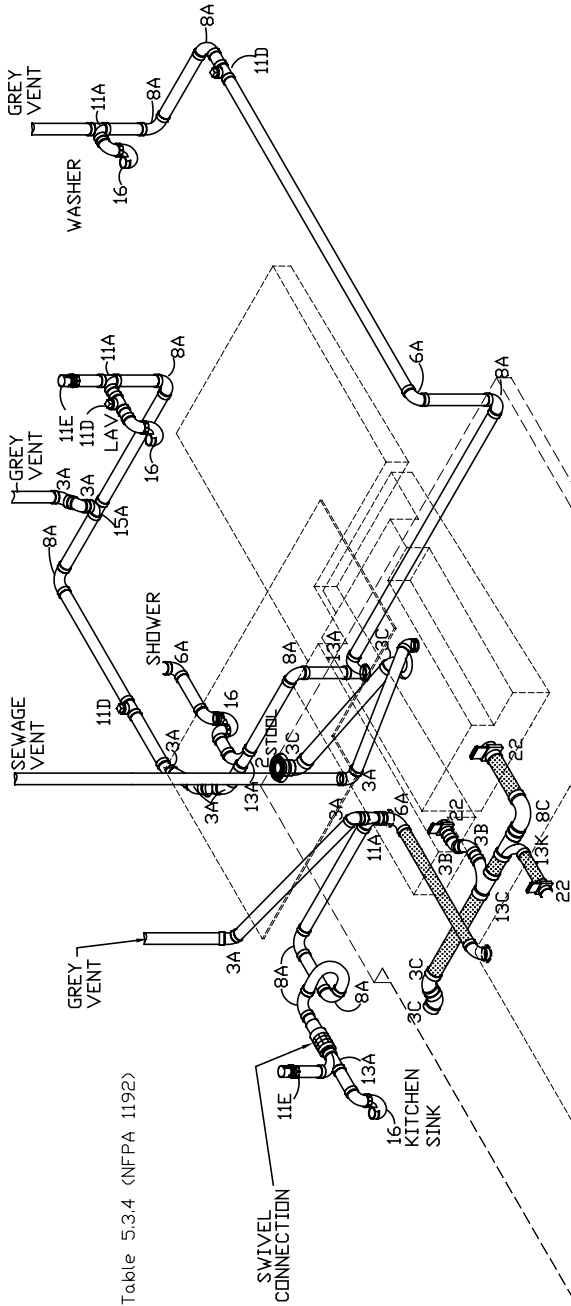

Mounting Clamp



-Rubber Coated Steel Clamp Used To Secure Gas Manifold

-Plastic Clamp Used To Secure Copper Tubing

-Grommets Used To Protect Copper Through Floors, Walls, Cab. Partitions Etc.

KEY	DESCRIPTION
1	1/2" BLK ELL
2	1/2" BLK TEE
3	1/2" FL x 3/8" BRASS UNION MPT

Revision:REV WASHER PLUMBING FITTINGS TO 1 1/2" (ECO#578)	By: M.B.
	Date:9/2/08
Revision:REVISED LOCATION OF SEWAGE TANK VENT PER (PCR #87179)	M.B.
	Date:4/2/08

Model: TPFW 35KSLR	Sheet 1 OF 3	Drawn by: T.M.	Checked by: D.B.
Title: DRAIN PLUMBING	I.D. # 2009/ TOW/CODE/PLUM/PP/FV35KSLR	Date: 3/4/08	Date: 3/10/08