



NOTES:

Maximum developed length - 70'

1/2" Black mall pipe

3/8" I.D. copper type "L"



Max. length of copper type to appliance per test

Propane Distribution System Complies With The Parameters Set By Table 5.3.4 (NFPA 1192)

All brass fittings below floor to be forged--not milled

Maximum developed length of flex hose - 72"

| MAX BTU VALUES |        |
|----------------|--------|
| FURNACE        | 40,000 |
| RANGE          | 29,800 |
| REFRIGERATOR   | 1,500  |
| WATER HEATER   | 12,000 |
| TOTAL BTU      | 85,300 |

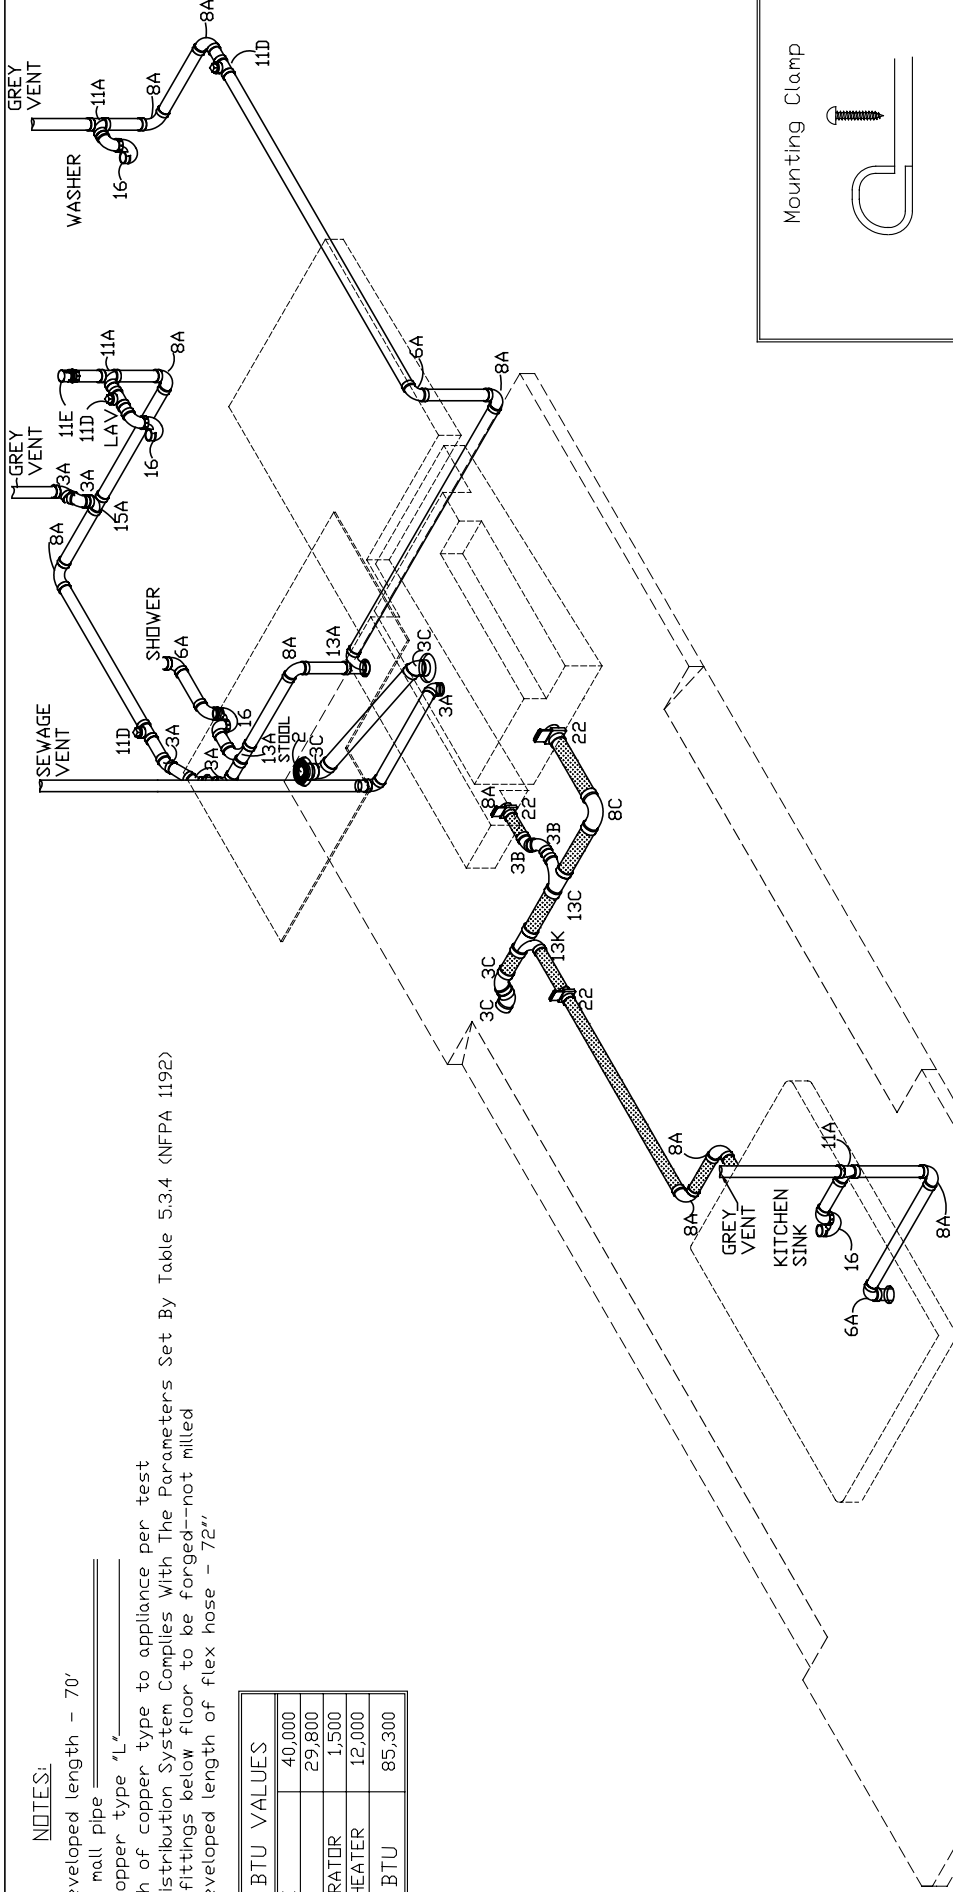

- Rubber Coated Steel Clamp Used To Secure Gas Manifold
- Plastic Clamp Used To Secure Copper Tubing
- Grommets Used To Protect Copper Through Floors, Walls, Cab. Partitions Etc.

| KEY | DESCRIPTION                    |
|-----|--------------------------------|
| 1   | 1/2" BLK ELL                   |
| 2   | 1/2" BLK TEE                   |
| 3   | 1/2" FL x 3/8" BRASS UNION MPT |

|                                                                                |                          |                                        |                    |                      |                                                           |              |
|--------------------------------------------------------------------------------|--------------------------|----------------------------------------|--------------------|----------------------|-----------------------------------------------------------|--------------|
| NEWMAR CORP<br>P.O. Box 30,<br>Nappanee, IN. 46550<br>Title block--PB_TB-T4_09 | Model:<br>TPFW 37RKS     | Sheet<br>1 OF 3                        | Drawn by:<br>M. B. | Checked by:<br>D. B. | Revision/REV WASHER PLUMBING FITTINGS TO 1 1/2" (ECO#578) |              |
|                                                                                | Title:<br>DRAIN PLUMBING | I.D. # 2009/<br>TOW/COE/PLUMB/PFW37RKS | Date:              | Date:                | By:                                                       | Date: 9/2/08 |
|                                                                                |                          | Date:                                  |                    | Date:                | Date:                                                     |              |
|                                                                                |                          | Date:                                  |                    | Date:                | Date:                                                     |              |