

NOTES:

Maximum developed length - 70'

1/2" Black malleable pipe

3/8" I.D. copper type "L"



Max. length of copper type to appliance per test

Propane Distribution System Complies With The Parameters Set By Table 5.3.4 (NFPA 1192)

All brass fittings below floor to be forged--not milled

Maximum developed length of flex hose - 72'

MAX BTU VALUES	
FURNACE	40,000
RANGE	29,800
REFRIGERATOR	1,500
WATER HEATER	12,000
TOTAL BTU	85,300

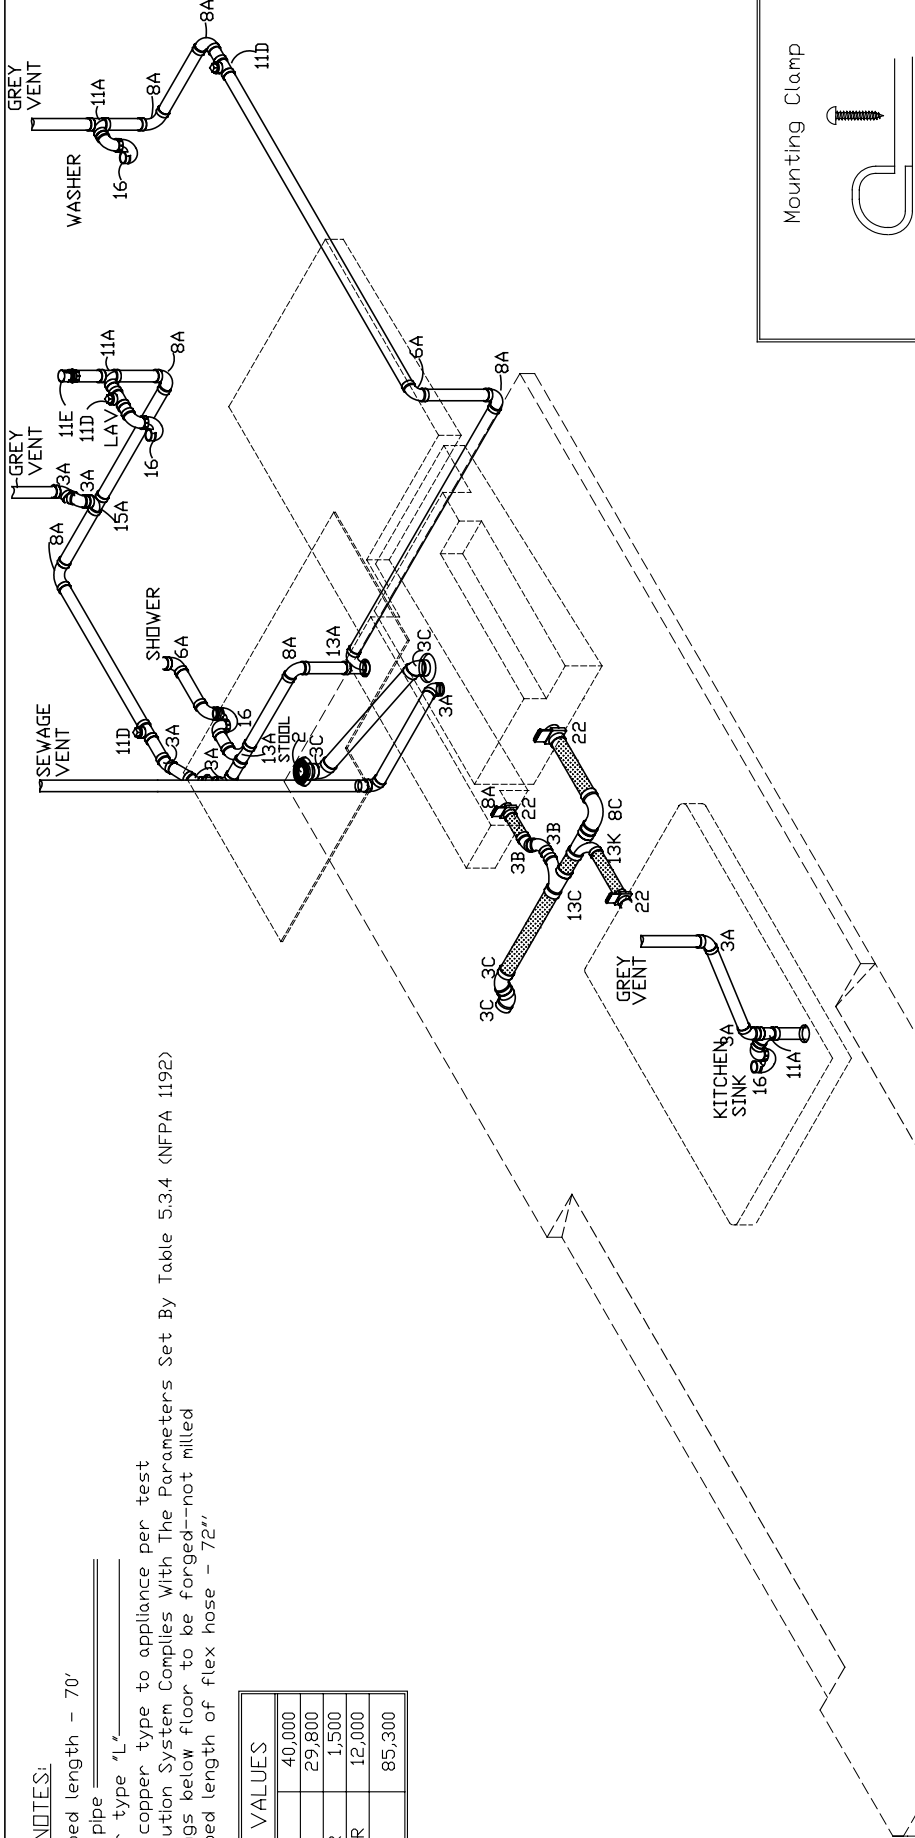



- Rubber Coated Steel Clamp Used To Secure Gas Manifold
- Plastic Clamp Used To Secure Copper Tubing
- Grommets Used To Protect Copper Through Floors, Walls, Cab. Partitions Etc.

KEY	DESCRIPTION
1	1/2" BLK ELL
2	1/2" BLK TEE
3	1/2" FL x 3/8" BRASS UNION MPT

Model: TPFW 38LSHS	Sheet 1 OF 3	Drawn by: M. B.	Checked by: D. B.	Revision: REV WASHER PLUMBING FITTINGS TO 1 1/2" ECO#578	
				By: M. B.	Date: 9/2/08
Title: DRAIN PLUMBING	I.D. # 2009/ TOW/CODE/PLUMB/PP/FV38LSHS	Date: 10/29/07	Date: 11/30/07	Revision: OMITTED GREY VENT, REVISED LOCATION OF SEWAGE TANK VENT PER (PCR #87#99)	
				By: M. B.	Date: 1/24/08

NOTES:

All fresh water lines on Aires are 1/2" TuffPex-A
All Fresh water lines on Stars are 1/2" TuffPex-A
Drains are installed at low points
TEI listed swivel connections (listing #17062)
**-Denotes 1/2" x 48" Faucet riser
Install 18" high pressure hose at pump discharge

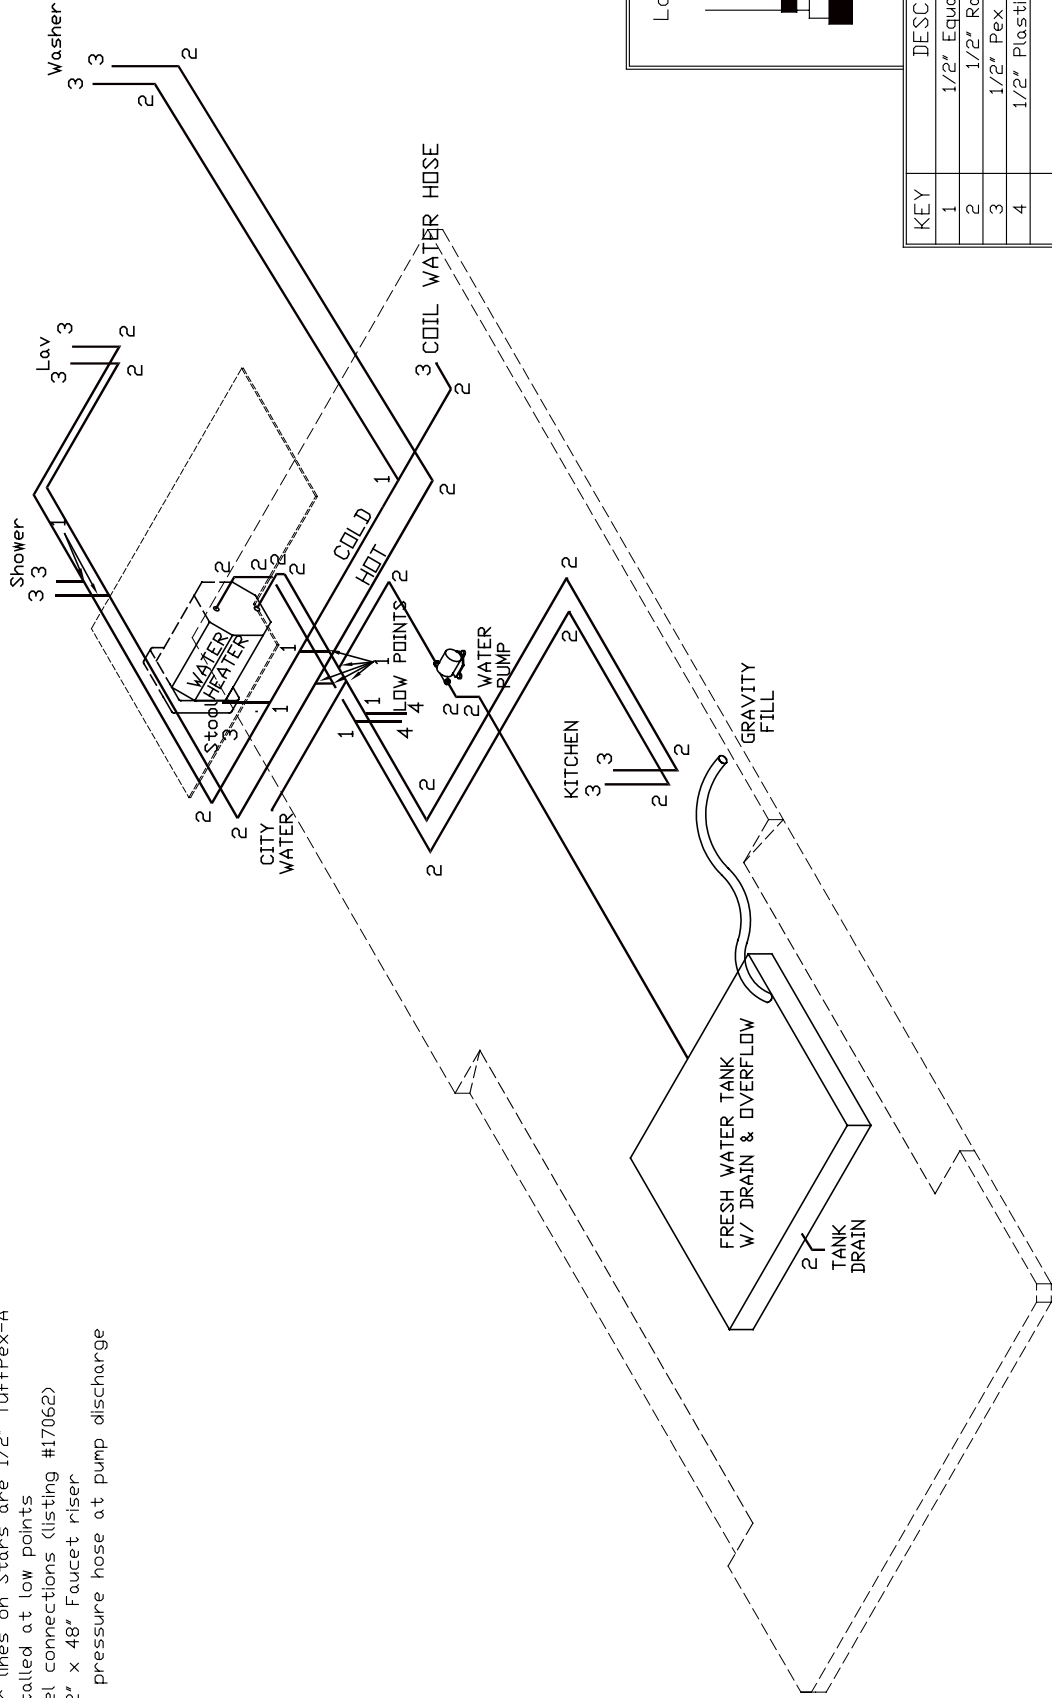

KEY	DESCRIPTION
1	1/2" Equal Radel Tee
2	1/2" Radel Elbow
3	1/2" Pex x 1/2" MNPT
4	1/2" Plastic Cap W/Seal

NEWMAR CORP P.O. Box 30, Nappanee, IN. 46550 Title block--PB_TB-T4_09	Model: TPFW 38LSHS Title: WATER LINES	Sheet 2 OF 3	Drawn by: M. B.	Checked by: D. B.	Revision:
		I.D. # 2009/ TDW/CODE/PLUM/PP/FW38LSHS	Date: 10/29/07	Date: 11/30/07	Revision: