


NOTES:

Maximum developed length - 70'

1/2" Black mall pipe _____
3/8" I.D. copper type "L" _____

Max. length of copper type to appliance per test
Propane Distribution System Complies With The Parameters Set By RVIA Test By Table 53.4 (NFPA 1192)
All brass fittings below floor to be forged---not milled
Maximum developed length of flex hose - 72"

MAX BTU VALUES	
FURNACE	40,000
RANGE	29,800
REFRIGERATOR	1,500
WATER HEATER	12,000
TOTAL BTU	85,300

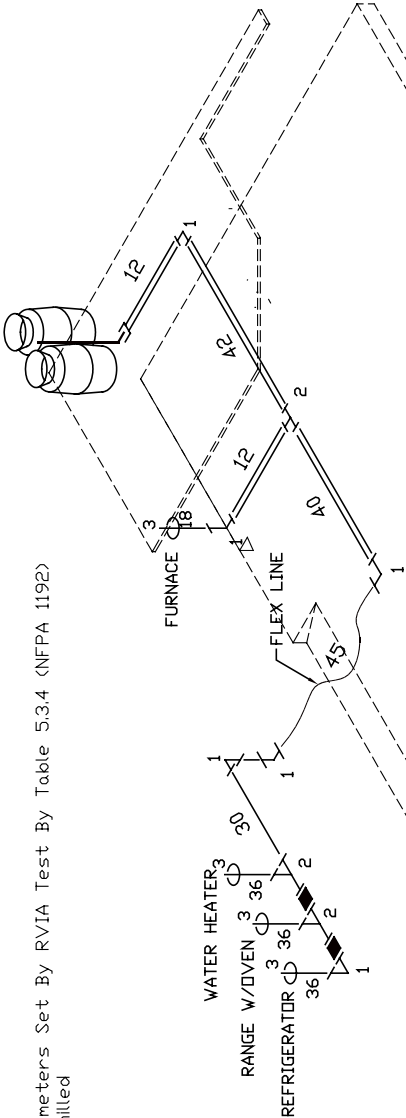

NEWMAR CORP P.O. Box 30, Nappanee, IN. 46550		Model: XAF W 39KSTH		Sheet 3 OF 3	Drawn by: T. M.	Checked by: D. B.	Revision:REV MAX BTU FOR FURNACE TO 40000 ILD 42000 (ECO #728)								
Title: PROPANE GAS		I.D. # 2009/ TOW/CODE/PLUM/W/FV39KSTH		Date: 1/3/08	Date: 3/4/08	By: M.B. Date:9/9/08									
Title block--PB_TB-T4_08						By: Date:									
<table><thead><tr><th>KEY</th><th>DESCRIPTION</th></tr></thead><tbody><tr><td>1</td><td>1/2" BLK ELL</td></tr><tr><td>2</td><td>1/2" BLK TEE</td></tr><tr><td>3</td><td>1/2" FL x 3/8" BRASS UNION MPT</td></tr></tbody></table>								KEY	DESCRIPTION	1	1/2" BLK ELL	2	1/2" BLK TEE	3	1/2" FL x 3/8" BRASS UNION MPT
KEY	DESCRIPTION														
1	1/2" BLK ELL														
2	1/2" BLK TEE														
3	1/2" FL x 3/8" BRASS UNION MPT														
Mounting Clamp -Rubber Coated Steel Clamp Used To Secure Gas Manifold -Plastic Clamp Used To Secure Copper Tubing -Grommets Used To Protect Copper Through Floors, Walls, Cab. Partiti Etc.															