


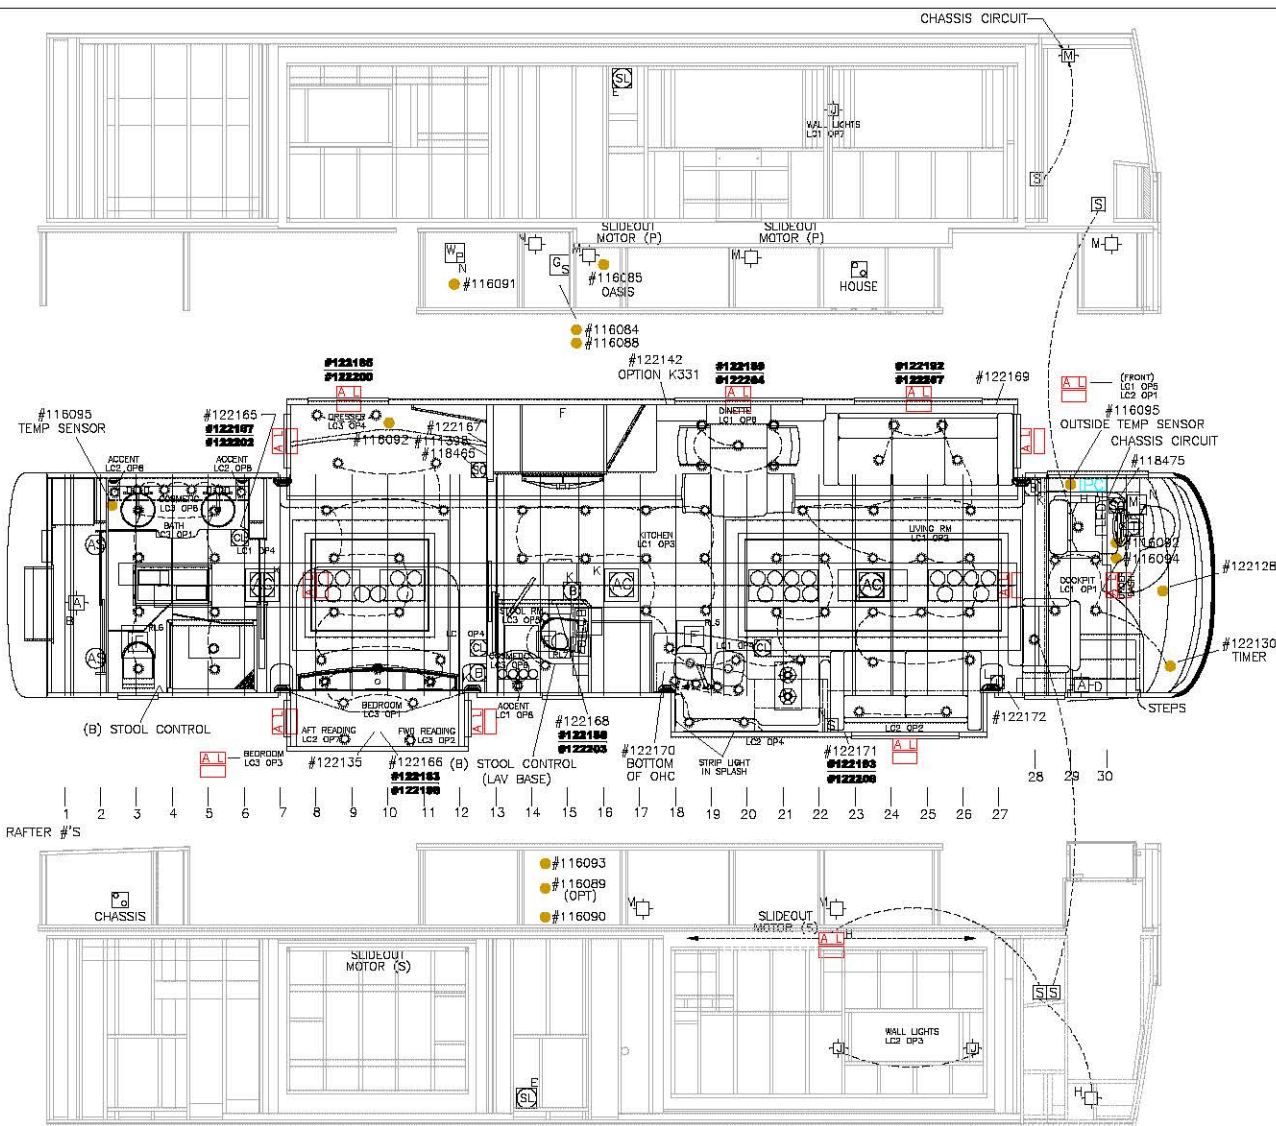

ELECTRICAL SYMBOLS

WORKING CLEARANCE MIN. 24W/22D

NOTE: MAINTAIN WORKING CLEARANCE
AT ELECTRIC PANEL

	POWER CORD		110V LIGHT
	110V RECEPT W/USB PORTS		120vdc DIMMER LIGHT
	INVERTER/CONVERTER		110V SWITCH
	120vac BREAKER BOX		110V RECEPT
	120vdc BREAKER BOX (DRAWN)		COMP. BT. BREAKER & RECEPT
	HYDRONIC HEAT SYSTEM		T.V.
	AIR CONDITIONER		STEREO
	MONITOR PANEL		110V JUNCTION BOX

NOTES:
(STD) DUO
N281 SILHOUETTE
30A CIRCUITS WIRED W/1-2 ROMEX TYPE NM-B.
20A CIRCUITS WIRED W/1-2 ROMEX TYPE NM-B.
15A CIRCUITS WIRED W/14-2 ROMEX TYPE NM-B.
ALL PRE-WIRE FOR AIR USE 20 AMP FUSE AT BREAKER BOX.
CANADA ONLY: ALL GENERAL PURPOSE CIRCUITS TO BE 15A MAX.

SOME CIRCUITS MAY NOT APPLY TO
CERTAIN BRAND AND TYPE UNITS.

CIRCUIT	FUSE	BREAKER	LOAD
1	20 Amp	HACR	Front air conditioner
3A	20 Amp	HACR	Hydronic Heat System
3B	20 Amp	HACR	Hydronic Heat System
5	20 Amp	HACR	Rear air conditioner
7	20 Amp	HACR	Center air conditioner
8	20 Amp	HACR	Dryer
9	15 Amp	HACR	Washer
10	15 Amp	HACR	Block heater
11	15 Amp	HACR	Heat pads
13	15 Amp	HACR	Freezer
14	15 Amp	HACR	Wash/dry combo
15	30 Amp	HACR	Inverter/Converter - subpanel
18	15 Amp	HACR	Refr

50 Amp Service
w/ Invt
and
Subpanel

CIRCUIT	FUSE	BREAKER	LOAD
2	20 Amp	HACR	Microwave
4	20 Amp	HACR	Lights/General recepts
9	20 Amp	HACR	Kitchen recept(s)
12	20 Amp	HACR	Kitchen recept

NEWMAR CORP
P.O. Box 30,
Nappanee, IN. 46550

Model:
KG DB 4584
Title: HALOGEN LIGHT LAYOUT/
SWITCHES/12V

Sheet
2 OF 4
I.D. # 2014\
HE\CODE\ELEC\KG\4584


Drawn by:
B. G.
Date:
2/19/13

Checked by:
D. K.
Date:
2/28/13

Revision:ADDED NOTE TO WORKING CLEARANCE IN UPPER/RIGHT CORNER
Revision:MOVED S-O SWITCH FROM STOOL ROOM WALL TO BACK SIDE OF ODS 3" WALL
(ECO 19)

By: B. G.
Date: 4/17/13
By: B. G.
Date: 4/3/13

Title block: EL_TB-EXKG_14

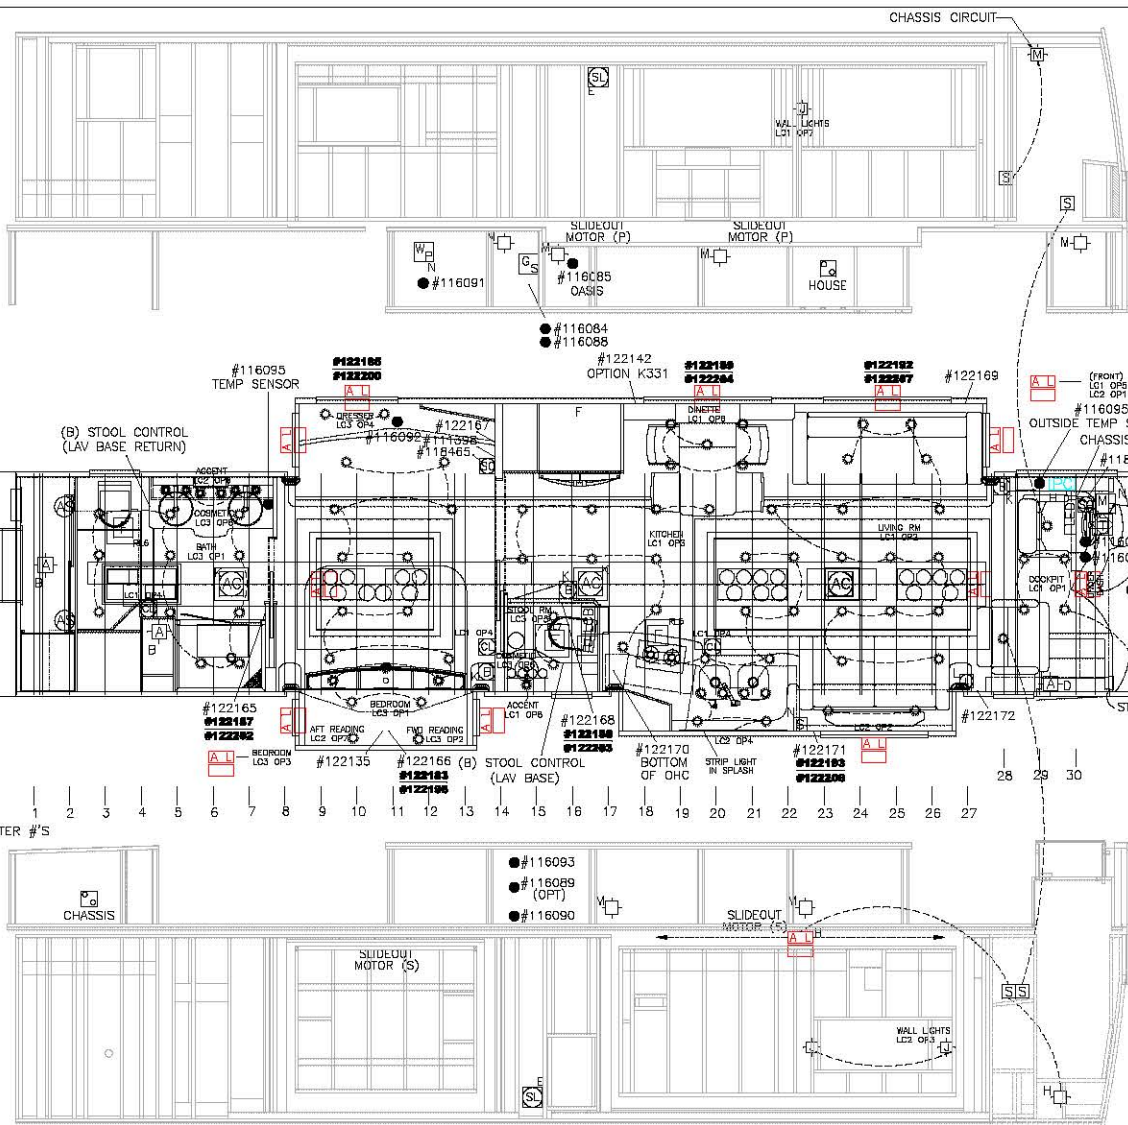

ELECTRICAL SYMBOLS

WORKING CLEARANCE MIN. 24Wx22D

NOTE: MAINTAIN WORKING CLEARANCE
AT ELECTRIC PANEL

- (PC) POWER CORD
- 110V RECEPT W/USB PORTS
- INVERTER/CONVERTER
- 120vac BREAKER BOX
- 120vac BREAKER BOX (CANADA)
- HYDRONIC HEAT SYSTEM
- AIR CONDITIONER
- MONITOR PANEL
- 110V LIGHT
- 120vac DINETTE LIGHT
- 110V SWITCH
- 110V RECEPT
- COMP. GFI BREAKER & RECEPT
- T.V.
- STEREO
- 110V JUNCTION BOX

NOTES:
(STD) DUO
N281 SILHOUETTE
30A CIRCUITS WIRED W/12-2 ROMEX TYPE NM-B.
20A CIRCUITS WIRED W/14-2 ROMEX TYPE NM-B.
15A CIRCUITS WIRED W/14-2 ROMEX TYPE NM-B.
ALL PRE-WIRE FOR AIR USE 20 AMP FUSE AT BREAKER BOX.
CANADA ONLY: ALL GENERAL PURPOSE CIRCUITS TO BE 15A MAX.

SOME CIRCUITS MAY NOT APPLY TO
CERTAIN BRAND AND TYPE UNITS.

CIRCUIT	FUSE BREAKER	LOAD
1	20 Amp HACR	Front air conditioner
3A	20 Amp HACR	Hydronic Heat System
3B	20 Amp HACR	Hydronic Heat System
6	20 Amp HACR	Rear air conditioner
7	20 Amp HACR	Center air conditioner
8	20 Amp HACR	Dryer
9	15 Amp HACR	Washer
10	15 Amp HACR	Block heater
11	15 Amp HACR	Heat pads
13	15 Amp HACR	Freezer
14	15 Amp HACR	Wash/dry combo
15	30 Amp HACR	Inverter/Converter - subpanel
16	15 Amp HACR	Refr

CIRCUIT	FUSE BREAKER	LOAD
2	20 Amp HACR	Microwave
4	20 Amp HACR	Lights/General recepts
5	20 Amp HACR	Kitchen recept(s)
12	20 Amp HACR	Kitchen recept

50 Amp
Service
w/ inv
and
Subpanel

NEWMAR CORP P.O. Box 30, Nappanee, IN. 46550 Title block: EL_TB-EXKG_14	Model: KG DB 4593	Sheet 2 OF 4	Drawn by: B. G.	Checked by: D. K.	Revision:ADDED NOTE TO WORKING CLEARANCE IN UPPER/RIGHT CORNER	By: B. G.
	Title: HALOGEN LIGHT LAYOUT/ SWITCHES/12V	I.D. # 2014\HE\CODE\ELEC\KKG\4593	Date: 1/4/13	Date: 1/16/13	Revision:MOVED S-O SWITCH FROM STOOL ROOM WALL TO BACK SIDE OF ODS 3" WALL (ECO 19)	Date: 4/17/13 By: B. G. Date: 4/3/13